


AHU-4


AHU-5 will require field verification by Contractor



AHU-6

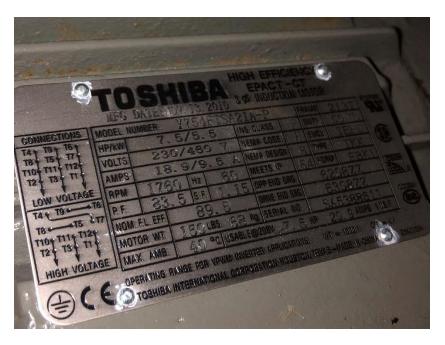


AHU-7

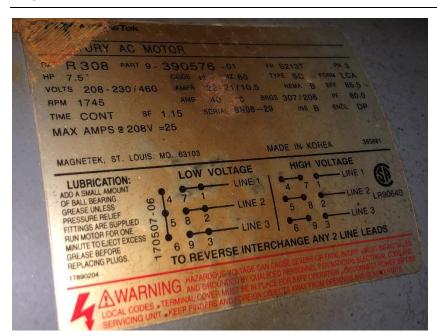

AHU-8



AHU-9

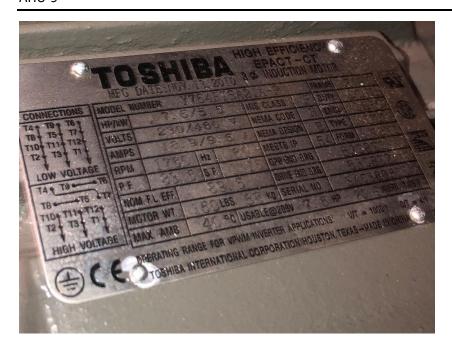

AHU-10

Alternate #1 Air Exchanger will require field verification by the Contractor