


1
P101

PARTIAL FACILITY PLAN –
NATURAL GAS (BASE BID AND ALTERNATES)
SCALE: 3/32" = 1'-0"

sims group
CONSULTING ENGINEERS, PC
PO BOX 5534 • ASHEVILLE, NC 28813
PHONE: 828-251-2025 • FAX: 828-251-1933
www.simgroupengineers.com
NORTH CAROLINA LICENSE #002684
THIS DRAWING IS THE PROPERTY OF SIMS GROUP. IT MAY NOT BE REPRODUCED OR USED IN ANY MANNER WITHOUT PERMISSION.

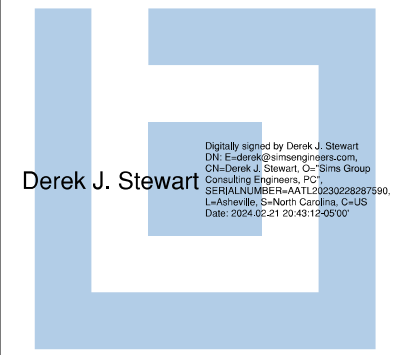

ATKINSON ELEMENTARY SCHOOL
HVAC CHANGEOUT PHASE I
2510 OLD KANUGA RD. HENDERSONVILLE, NC 28739

DATE: 02/21/24


DESIGN BY: DJS

DRAWN BY: RKH/PAM


APPROVED BY: DJS

SHEET NUMBER:

P101

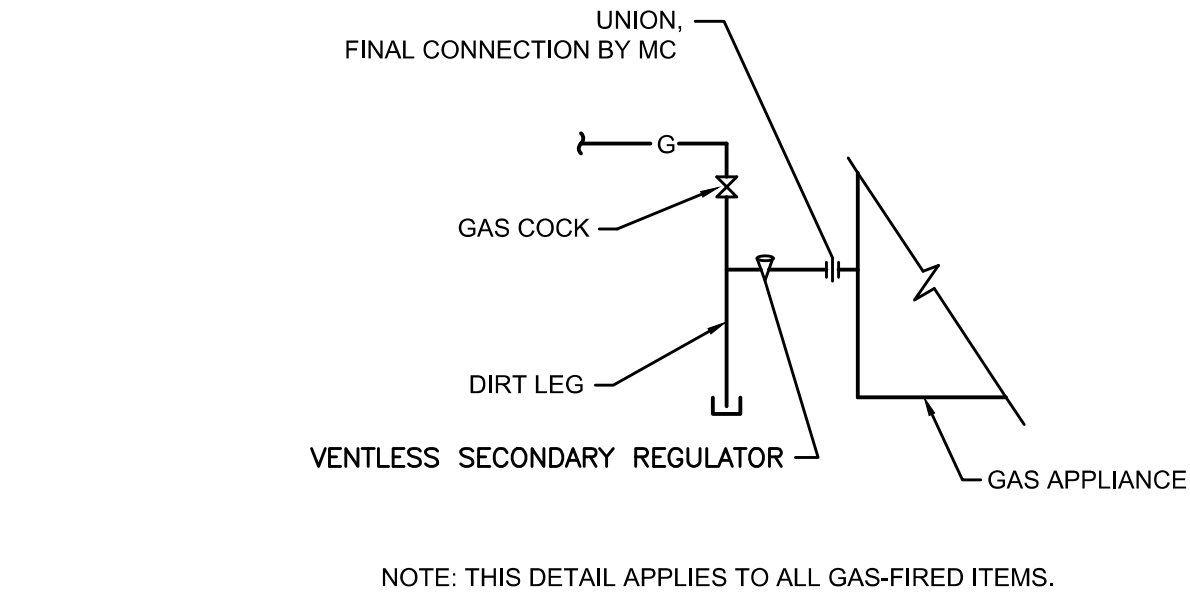

1 GAS PIPING CONNECTION DETAIL
P201 NOT TO SCALE

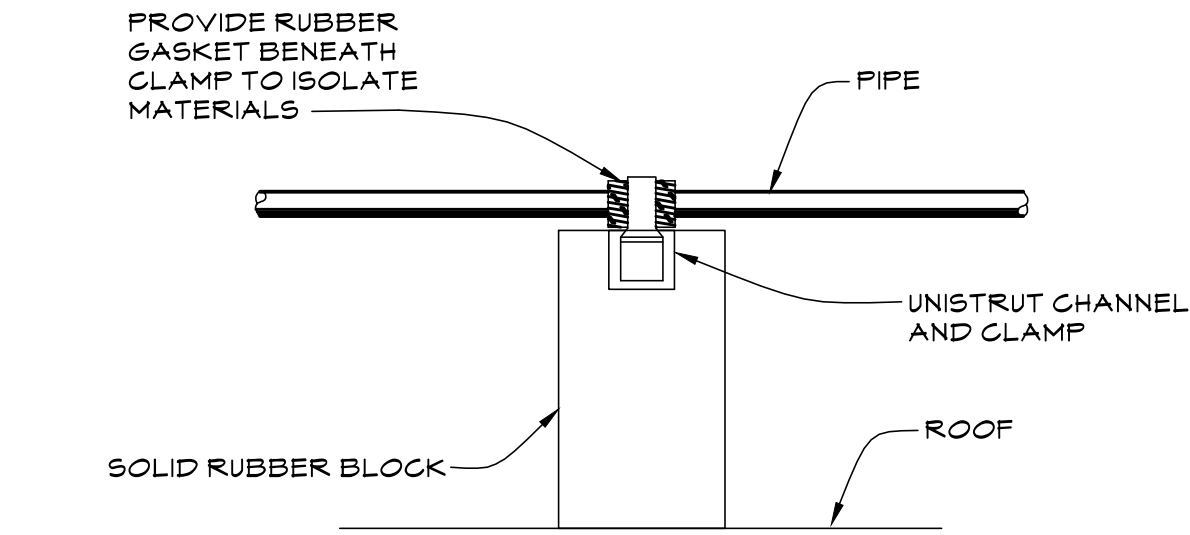


2 PIPE ON ROOF SUPPORT DETAIL
P201 NOT TO SCALE

NOTES:
1. HENDERSON COUNTY PUBLIC SCHOOLS MAY ALLOW APPROVED EQUAL ENGINEERED PIPE SUPPORT SYSTEMS.

PLUMBING LEGEND	
MARK	DESCRIPTION
	DOMESTIC COLD WATER PIPING SHALL BE COPPER.
---	ABOVE GRADE -- RIGID TYPE "L" INSULATE W/1" FIBERGLASS PIPE INSULATION INSIDE BUILDING ENVELOPE.
----	UNDER SLAB AND BELOW GRADE -- ANNEALED TYPE "K" MINIMAL JOINTS UNDER SLAB. IF JOINTS UNDER SLAB REQUIRED, BRAZE JOINTS.
	UPONOR BRAND OR EQUAL PEX PIPING AND FITTINGS ARE AN ACCEPTABLE ALTERNATE TO COPPER
----	120° HOT WATER, SAME AS ABOVE
----	HOT WATER RETURN, SAME AS ABOVE
	SOIL PIPING IN NON-PLENUM RATED INSTALLATIONS SHALL BE SOLID CORE SCHEDULE 40 PVC. FOAM CORE PVC IS NOT ACCEPTABLE
	SOIL PIPING IN RETURN AIR PLENUM RATED INSTALLATIONS SHALL BE NO-HUB SERVICE WEIGHT CAST IRON
----	VENT PIPING IN NON-PLENUM RATED INSTALLATIONS SHALL BE SOLID CORE SCHEDULE 40 PVC. FOAM CORE PVC IS AN ACCEPTABLE ALTERNATE.
----	VENT PIPING IN RETURN AIR PLENUM RATED INSTALLATIONS SHALL BE NO-HUB SERVICE WEIGHT CAST IRON
⌵	CUTOUT VALVE, GATE OR BALL, BRONZE, SIZE TO EQUAL PIPE, APPROVED FOR POTABLE WATER SYSTEMS
⌵	GATE OR BALL VALVE, BRONZE, SIZE TO EQUAL PIPE APPROVED FOR POTABLE WATER SYSTEMS
⌵	CHECK VALVE SAME AS ABOVE
VTR	VENT THROUGH ROOF, EXTEND 6" ABOVE ROOF, PENETRATE BEHIND ROOF PEAK OR PARAPET, PAINT TO MATCH ROOF, COORDINATE FLASHING WITH ROOF. MAINTAIN 10' CLEARANCE FROM HVAC MAKE-UP AIR INTAKES
G	FUEL GAS PIPING: 2.0 OR 0.5 PSI DELIVERY PRESSURE INSTALL PER N.C. GAS CODE SCHEDULE 40 BLACK STEEL. EXPOSED PIPING SHALL BE IDENTIFIED BY A YELLOW LABEL MARKED "GAS" IN BLACK LETTERS. THE MARKING SHALL BE SPACED AT INTERVALS NOT EXCEEDING 5 FEET. ALL PIPING AND TUBING SYSTEMS, GREATER THAN 0.5 POUNDS PER SQUARE INCH SERVICE PRESSURE, SHALL BE IDENTIFIED BY A YELLOW LABEL WITH BLACK LETTERS INDICATING THE PIPING SYSTEM PRESSURE. THE SYSTEM SHALL BE MARKED AT THE BEGINNING, ALL ENDS AND AT INTERVALS NOT EXCEEDING 5 FEET ALONG ITS EXPOSED LENGTH.

NOTE:
1. ALL NEW WATER SUPPLY PIPE FITTINGS SHALL COMPLY WITH NCPC 605.5
2. ALL NEW SANITARY PIPE MATERIAL SHALL COMPLY WITH NCPC 702.1
3. ALL NEW SANITARY PIPE FITTINGS SHALL COMPLY WITH NCPC 702.4

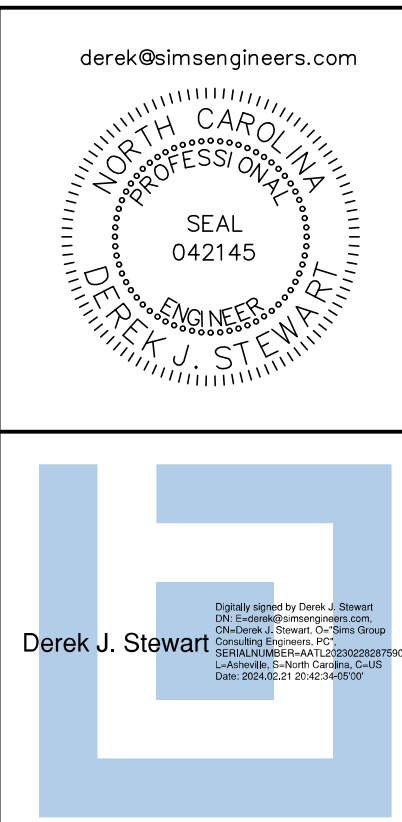

ATKINSON ELEMENTARY SCHOOL


HVAC CHANGEOUT PHASE I
2510 OLD KANUGA RD. HENDERSONVILLE, NC 28739

DATE:	02/21/24
DESIGN BY:	DJS
DRAWN BY:	RKH/PAM
APPROVED BY:	DJS
SHEET NUMBER:	


P201

SECTION 15010P BASIC PLUMBING REQUIREMENTS														
1. PART 1 GENERAL	2. PART 2 DESCRIPTION OF WORK													
1.1 SECTION INCLUDES	2.1 GENERAL DESCRIPTION OF WORK	2.1.1 ACCESSIBILITY:												
A. Basic Plumbing Requirements specifically applicable to Division 15 Sections, in addition to Division 1 – General Requirements.	A. Coordinate work with other trades. B. Plumbing Contractor shall provide all fuel gas, water, soil and vent piping. C. Fire stop all penetrations through rated assemblies. See Architectural sheets for locations of rated assemblies. D. Provide all valves, fixtures, pipes, pumps, insulation, etc. and other required material. E. All major pieces of material shall be produced by the same manufacturer. F. Plumbing Contractor shall provide all penetrations, etc. and patching required to install plumbing work. G. Provide stops for each fixture. Exposed stops and supplies shall be chrome plated. H. Coordinate oil required starters, disconnects, switches with Electrical Contractor for installation. Coordinate electrical requirements for equipment supplied with Electrical Contractor prior to ordering equipment. I. Provide warning tape in trench with buried pipe. Locate tape 6" below finish grade directly above pipe. J. Provide fuel gas piping to equipment as required with gas approved shut offs at each equipment item.	A. No valves, controls, unions, etc., shall be placed in any pipe line at a location that will be inaccessible after the system is completed. B. Any controls, valves and piping controls, expansion joints, or other apparatus which must be located in an inaccessible location shall be provided with suitable access doors (fitted in a framed hole) which will permit proper operation and servicing of the apparatus. Access doors aforementioned includes access doors in walls, ceilings, and, where required, a combination of above. Access doors to be piano hinged. C. Floor drains and floor sinks shall not be installed under equipment. They must be visible and easily accessible. Place them straddling the front edge of equipment. They are a tripping hazard if they are placed too far into the room. Do not install dumpster pad drain under dumpster.												
1.2 SCOPE OF WORK	2.2 PIPING:	2.1.2 EXCAVATING FOR PLUMBING WORK												
A. Provide controls, valves, piping, plumbing fixtures, taps, water heater flues and other required materials to produce complete and operating plumbing system as shown on drawing. B. Provide controls, valves, piping, taps and other required materials to produce complete and operating fuel gas system as shown on drawing. C. Provide demolition of all Plumbing and Fuel Gas fixtures and materials made obsolete by this project and remove from site. Owner retains salvage rights. D. Obtain all permits, pay all fees and request inspection from authority having jurisdiction. E. All work and materials shall be guaranteed for one year from date of substantial completion. F. Provide for water service during construction. The Owner will be responsible for bill.	A. Cold water service line to 5' from building: "K" copper, annealed. Tubing shall be approved for potable service. 36" below grade. Provide warning tape 6" below grade above tubing. B. Cold water and hot water: From 5' from building and distribution: Copper, annealed "K" below grade and under slab. Minimal joints under slab. Rigid "L" above grade. Insulate piping above grade with 1" pre-formed fiberglass pipe insulation. Provide pre-formed PVC fitting covers. Solder shall be lead free. Braze joints below grade and under slab. C. Soil Piping: Schedule 40 PVC except bell and spigot, cast iron under vehicular traffic areas and burial depths less than 24". D. Vent Piping: Schedule 40 PVC. Coordinate vent termination locations with Owner prior to starting work. Paint to match building. E. Fuel gas piping: Schedule 40 black steel. Coat and wrap piping installed below grade. F. Support piping with threaded rods and hangers, channel trapeze, channel and clamps, or some other approved method from the building structure.	A. General: The work of this article is defined to include whatever excavating and backfilling (but excluding insulating backfill) is necessary to install the plumbing work. Coordinate the work with other excavating and backfilling in the same area, including dewatering, floor protection provisions, and other temporary facilities. Coordinate the work with other work in the same area, including other underground services, landscape development, paving, and floor slabs on grade. Coordinate with weather conditions and provide temporary facilities needed for protection and proper performance of excavating and backfilling. B. General Standards: Except as otherwise indicated, comply with the applicable provisions of the Division 2 sections, for plumbing work excavating and backfilling. Refer instances of uncertain applicability to the Engineer for resolution before proceeding. C. Rock Excavation shall be defined as the removal of a formation that cannot be excavated without systematic drilling and blasting or without the use of pneumatic tools. All rock excavation/removal shall be performed by the General Contractor. The Plumbing, Mechanical, and Electrical subcontractors shall lay out their work and perform all normal or earth excavation. Should these subcontractors encounter rock (bulk or trench), it shall be removed by the General Contractor using allowable funds. The General Contractor shall be responsible for providing fill material for backfill of rock excavations. Rock may be used for structural fill provided it is broken down by the excavation and compaction equipment into particles with a maximum dimension of 6". Otherwise, it must be removed from the site and legally disposed of. Placement of rock in the fill or removal from the site shall be done by the General Contractor at no additional cost to the Owner. D. Piping Support: Support pipe 4" and smaller directly on undisturbed soil. Support pipe 6" and larger, on compacted and shaped sub-base material of depth shown but not less than 6" deep. Compact previously disturbed and unsatisfactory subsoil to provide adequate, uniform support for plumbing work; or excavate and replace with stable sub-base material or lean concrete. E. Water Bearing Pipe: Except as otherwise specifically indicated, place exterior underground water bearing pipe (including drainage lines) a minimum of 36" below grade (measured to top of pipe). F. Sequencing: Delay backfill and encasement of piping until testing of piping system has been completed.												
1.3 WORK SEQUENCE	2.3 FIXTURES	2.1.3 PAINTING PLUMBING WORK												
A. Coordinate construction and utility outages (if any) with Owner, Engineer, all other trades and utility companies. B. Visit site before submitting bid to confirm existing conditions. Notify Engineer of discrepancies in the Contract Documents and existing conditions. C. Please E-Mail questions and or comments to derek@simsengineers.com or fax (828-251-1933) in lieu of telephone calls.	A. See fixture schedule on drawing.	A. General: All piping in the mechanical rooms (3) to be painted in the colors as scheduled herein. Refer to Contract Documents for type of paint to be used. All other piping in building requires no painting other than the sizing of the insulation jackets. Contractor to provided color stenciling of piping for identification; touching up paint that is chipped or scratched from mechanical equipment supplied; and 2 coats of black rust preventative on all exposed support metal and hangers mounted outdoors and in mechanical rooms. B. Color Coding Scheme: (Unless violates OSHA Standards) Domestic Water, Cold: Kelly or Safety Green with White arrows and letters. Domestic Water, Hot: Safety Green with Red arrows and letters. Fuel Gas: Safety yellow with red arrows and letters. C. Cleaning, Testing, Adjustments and Inspections shall be accomplished in accordance with the following instructions and requirements. Provide temporary fill and drainage lines, wherever required, and connect them to the piping systems for these procedures and, finally, upon completion disconnect and remove these temporary lines. D. Cleaning and Oiling: All piping systems shall be thoroughly cleaned of grease, iron cuttings, welding slag, loose scale and other refuse. Should any pipe, valves, traps, strainers, and other specialties, and equipment be stopped up by refuse, disconnect, clean and reconnect such pipe, equipment and material. All strainer baskets shall be removed, cleaned and replaced. Exterior surfaces of piping, materials, or equipment that is to be painted or insulated shall be cleaned to remove lint, grease and oil.												
1.4 SUBMITTALS	2.4 WIRING	2.1.4 TESTS												
A. Submit under provisions of Contract Documents. B. Submit shop drawings and product data grouped to include complete submittals of related systems, products, and accessories in a single submittal. Identify items with marks to match those shown on drawings. C. Mark dimensions and values in units to match those specified. D. Architect will approve all colors. E. All submittals shall have the General Contractor's stamp, with approval signature. F. Highlight deviations from specified materials. G. Shop Drawings: 6 sets, including 3 for maintenance manuals. H. Product Data: 6 sets, including 3 sets for maintenance manuals. Data shall include the following, but not limited to: 1. Pressure Reducing Valves 2. Insulation 3. Plumbing Fixtures 4. Floor Drains, Cleanouts, Accessories 5. Valves I. Certifications: 3 copies J. Test Reports: 3 copies K. Warranties (Guarantees): 6 copies, including 3 for maintenance manuals. L. Maintenance Manuals: 3 complete sets with individual sets of this data bound in 10 1/2 x 11 1/2 loose-leaf 3-ring binders, 1/2", 2", or 3" ring size, with rigid permanent vinyl covered back and front. Separators with index tabs and loose-leaf sheet protectors shall be provided. One set shall have all sheets individually encased in clear, plastic document protectors.	All control wiring (120V and less) to be complete to all motorized equipment, and control devices listed in this specification and shown on the mechanical drawings, shall be done under Division 15. The Contractor shall refer to Electrical plans and specifications to determine the source of electrical energy for the various control circuits. All wiring shall be in conduit, shall conform with Division 16 of these specifications, all local codes, the National Electrical Code, and shall be installed by an approved licensed electrician. Wiring diagrams indicating wire sizes and conduit runs for all electrical work that is required under this contract shall be submitted to the Engineer for prior approval before work is begun. Upon completion of the work, the wiring diagrams shall be revised to incorporate any additions or corrections and two copies of the "as installed" diagrams shall be furnished to the Owner and one to the Engineer on reproducible sepia paper. Wiring shown on electrical plans is for plumbing equipment scheduled. Any equipment provided by the Contractor that differs from that scheduled in electrical characteristics that requires additional voltage, electrical design and/or electrical cost changes shall be the responsibility of this Contractor. Any cost incurred for additional electrical design and/or electrical changes due to any equipment other than equipment scheduled, shall be the responsibility of this Contractor. In general interlock wiring between pieces of plumbing equipment shall be done under Division 15P (Example: Power exhaust fan interlock with water heater).	Provide written test results to the Engineer. Provide one week notice prior to all tests. A. Soil Lines and Waste & Vent Stacks. After the lines and various connections are in place, all openings, including vents, shall be carefully closed and the whole system filled with water to ten feet of head and test for 6 hours. Any pipe, fitting or joint showing defect shall be immediately removed and replaced and the test reapplied. B. Domestic Water Lines. After lines are in place and before concealing, all water lines shall be subjected to hydrostatic pressure of 150 lbs. for a period of at least 6 hours. C. Fuel gas piping. After lines are in place and before concealing, all fuel gas lines shall be subjected to a pressure of 15 lbs. for a period of at least 6 hours or as required by Code or fuel gas utility. D. Adjustments shall be coordinated with cleaning and testing to assure equipment performance as specified. Water and electricity will be furnished by the Owner for the final operating tests. All unfired pressure vessels furnished under this division shall be constructed, inspected and stamped in accordance with applicable sections of the ASME Codes. Data shall include inspector's National Board registration number.												
1.5 REGULATORY REQUIREMENTS	2.5 FOUNDATIONS: All concrete foundations anchor forms, or pads indicated on the drawings that may be necessary and required for the installation of equipment specified under this contract, shall be furnished and installed. Provide anchor bolts for the equipment foundations/pads. Equipment to receive pads are pumps, boiler and air cooled chiller.													
A. Conform to applicable State and Local Building Codes. B. Fire Protection: Conform to NFPA. C. Electrical: National Electric Code. D. Life Safety Code, NFPA 101. E. All Codes shall be the most recent edition. F. The Contractor shall install all materials per the State and Local Building Code. Any work that does not comply shall be made to comply at the Contractor's expense. G. All equipment shall be UL approved for purpose specified. H. Install all materials and equipment per manufacturer's instructions.	2.6 MISCELLANEOUS STEEL SUPPORTS: All supporting steel grillage, steel angles, channels, pipe or structural steel stands, and anchoring devices that may be required to adequately and rigidly support either piping, insulation, or equipment installed under this contract, shall be provided and installed.													
1.6 PROJECT/SITE CONDITIONS	2.7 CHASES AND OPENINGS: Lay out all chases and openings, required for the execution of this work well in advance of the structural work. Provide thimbles in walls and partitions. Thimbles shall be standard weight galvanized steel pipe.													
A. Install Work in locations shown on Drawings, unless prevented by Project conditions. B. Prepare record drawings showing proposed rearrangement of Work to meet Project conditions, including changes to Work specified in other Sections. Obtain permission of Architect/Engineer before proceeding. Submit all changes on Record Documents as a requirement of project close out. C. Refer to Architectural drawings for dimensions, locations, cabinets, etc. Do not scale Plumbing Drawings. D. Conceal all piping except where the Architect/Engineer grants specific permission. E. Arrange mechanical work in a neat, well organized manner with piping and similar services running parallel with primary lines of the building construction. F. Locate operating and control equipment properly to provide easy access, and arrange entire mechanical work with adequate access for operation and maintenance. G. Give right-of-way to piping which must slope for drainage. H. Advise other trades of openings required in their work for the subsequent move-in of large units of mechanical work (equipment). I. Coordination Drawings: For locations where several elements of mechanical (or combined mechanical and electrical) work must be sequenced and positioned with precision in order to fit into the available space, prepare coordination drawings (shop drawings) showing the actual dimensions (at accurate scale) required for the installation. Prepare and submit coordination drawings prior to purchase-fabrication-installation of any of the elements involved in the coordination.	2.8 PLUMBING SYSTEM IDENTIFICATION: A. Piping System: All piping installed under this division of the specifications shall be identified as follows: B. Painting: Piping in mechanical rooms to be painted. Refer to "Painting Plumbing Work." C. Method of Marking: Colored stencil letter that designate the material being handled, shall be applied at not more than 15 foot intervals on straight pipe runs, adjacent to valves and where pipe passes through walls and floors. Piping shall be marked at all the equipment connections. All piping shall be identified. D. Identification: Lettering shall be stenciled in block letters, size as scheduled below. Letters on covered (insulated) pipe shall be stenciled on covering. On uncovered pipe, painted bands shall be wide enough (See Table 1) to accommodate required letters. Letters shall be positioned so that it can be easily read by a man standing on the floor. Lettering on parallel groups of lines shall be neatly lined up. Surfaces of piping or insulation finished in dark colored shall be lettered in white; and that finished in light colors shall be lettered in black. See "E" below for additional identification requirements for Gas Piping. All lines also shall be marked with arrows indicating the direction of flow.													
1.7 SUBSTITUTIONS	TABLE 1													
All products listed are to establish design and quality standards, not to limit submittals. Substitutions may be accepted if approved as equivalent. Contact Engineer prior to bid with any questions. All substitutions must be submitted within 10 days after bid or supply as specified. Highlight substitution deviations from materials specified. Cost incurred to the project to install substituted materials shall be the responsibility of the Contractor requesting the substitution.	<table><tr><td>Outside Diameter of Pipe or Converting (Inches)</td><td>Letter Size</td><td>Size of Letter (Inches)</td></tr><tr><td>1/2 to 1-1/4</td><td></td><td>1/2</td></tr><tr><td>1-1/2 to 2</td><td></td><td>3/4</td></tr><tr><td>2-1/2 to 8</td><td></td><td>1-1/4</td></tr></table> All dimensions are given in inches.	Outside Diameter of Pipe or Converting (Inches)	Letter Size	Size of Letter (Inches)	1/2 to 1-1/4		1/2	1-1/2 to 2		3/4	2-1/2 to 8		1-1/4	
Outside Diameter of Pipe or Converting (Inches)	Letter Size	Size of Letter (Inches)												
1/2 to 1-1/4		1/2												
1-1/2 to 2		3/4												
2-1/2 to 8		1-1/4												
1.8 Provide Valve Directory indicating number, size, manufacturer, location, function, and normal position. Valve tag numbers shall be as specified.	E. Gas Piping Identification: Exposed gas piping shall be identified by a yellow label marked "GAS" in black letters. The marking shall be spaced at intervals not exceeding 5 feet. All piping and tubing systems, greater than 0.5 pounds per square inch service pressure, shall be identified by a yellow label with black letters indicating the piping system pressure. The system shall be marked at the beginning, all ends and at intervals not exceeding 5 feet along its exposed length.													
1.9 Plumbing Equipment: Show the following information for all plumbing equipment: Nameplate designation Manufacturer's nameplate data Location of equipment Area served Complete parts drawing and list Manufacturer's operating instructions Manufacturer's maintenance instructions Manufacturer's repair manuals Manufacturer's installation instructions Nearest supplier for parts and replacements with telephone number Nearest service organization for equipment with telephone number	2.9 VALVE IDENTIFICATION A. Tags: Polished brass with 1/4" high stamp-engraved lettering, different shapes for each generic piping service. B. Application: Tag every valve and control device in each plumbing-work piping system; exclude check valves, valves within equipment units, and valves in fan coil units. C. Valve Schedule: Prepare and submit valve tag schedules (in duplicate), listing each tagged valve by location, service, and tag description. Install each page of one copy of the valve schedule in glazed frames, and mount where directed.													
1.10 Control Data: Provide control diagrams and wiring diagrams where applicable. Description of control systems. Catalog data, maintenance and calibration instruction for all components. Control supplier and address Control installer and address	2.10 EQUIPMENT A. Signs: Provide engraved plastic-laminate signs at locations of major equipment units and primary control devices. Provide text of sufficient clarity and lettering of sufficient size to convey adequate information at each location, and mount permanently in an appropriate and effective location. Comply with recognized industry standards for color and design. B. Selection: Refer to instances where either a plastic-laminate sign or plasticized tag might be appropriate to the Engineer for resolution.													
1.1.1 Maintenance Instruction: A typewritten form of instructions for maintenance of the systems in itemized form and with time schedule for maintenance work, shall be furnished. The instructions shall list each item of mechanical equipment requiring inspection, lubrication or service and describe the performance of such maintenance. The list shall include the type of bearings for each piece of equipment, the type of and frequency of lubrication required. The operating personnel shall be instructed in the care of the system in accordance with the typewritten instructions.		END OF SECTION												


1. BASE BID INCLUDES THE REMOVAL AND REPLACEMENT OF THE CURRENT P-TAC STYLE HVAC UNITS IN ALL CLASSROOM AREAS SHOWN ON THIS PLAN.
2. EXISTING CLASSROOM HVAC EQUIPMENT IS TO STAY IN SERVICE UNTIL THE NEW UNITS ARE FULLY FUNCTIONAL.
3. NEW WALL HUNG HVAC UNITS TO BE INSTALLED IN THE CORRIDORS AS SHOWN ABOVE, NO UNITS CURRENTLY IN THIS AREA.
4. FACTORY COMMISSION AND START-UP OF THE UNITS IS MANDATORY.
5. FACTORY INSPECTION AND HANDOVER INSPECTION WITH WRITTEN DOCUMENTATION FROM THE FACTORY AND ALL START UP DOCUMENTATION IS REQUIRED FOR FINAL PAYMENT ON THIS PROJECT.
6. UPON COMPLETION OF THE NEW HVAC SYSTEMS IN EACH CLASSROOM, EXISTING HVAC UNITS SHALL BE REMOVED COMPLETE AND MUST HAVE HOT WATER LINES CAPPED. THE CAPS MUST BE SOLDERED OR PRO-PRESSED, ANY OTHER MEANS OF ISOLATION WILL NOT BE ACCEPTED.
7. EXISTING HVAC UNITS ARE TO BE REMOVED AND STORED ON SITE FOR HENDERSON COUNTY PUBLIC SCHOOLS. ALL RECOVERED R-22 REFRIGERANT WILL BE RETURNED TO HENDERSON COUNTY PUBLIC SCHOOLS. HCPS MAINTENANCE DEPARTMENT WILL BE NEEDED RECOVERY TASKS FOR RECOVERED REFRIGERANT.
8. UPON REMOVAL OF THE EXISTING HVAC UNITS, WALL OPENINGS MUST BE SECURED IMMEDIATELY. TEMPORARY COVERS MUST BE WATERTIGHT AND RODENT PROOF UPON LEAVING THE SITE. TEMPORARY COVERS MUST BE SECURED FROM INSIDE OF THE BUILDING.
9. THE BASE BID TO INFILL WALL CAVITIES WHERE EXISTING HVAC UNITS ARE REMOVED SHALL BE: 8-INCH BLOCK LAID IN OPENING, WATERPROOFED, FINISHED AND PAINTED TO MATCH THE EXISTING EXTERIOR FINISH. INTERIOR FINISH OF BLOCK TO BE FLUSH WITH EXISTING WALL AND PAINTED TO MATCH THE EXISTING INTERIOR FINISH.
10. ADD-ALTERNATE #5: ALTERNATE BID TO INFILL WALL CAVITIES WHERE EXISTING HVAC UNITS ARE REMOVED SHALL BE: FRAMED 2X6 ON 16 "CENTERS MINIMUM, R-38 INSULATION, AT LEAST 7/16"WEATHER PROOF PLYWOOD WITH A MINIMUM OF A 1/2"BACKER BOARD WITH STUCCO TO MATCH THE EXISTING EXTERIOR FINISH. INTERIOR FINISH MUST BE FLUSH WITH EXISTING BLOCK WALL, CASED WITH 1X4 LUMBER, AND PAINTED TO MATCH THE EXISTING INTERIOR FINISH.

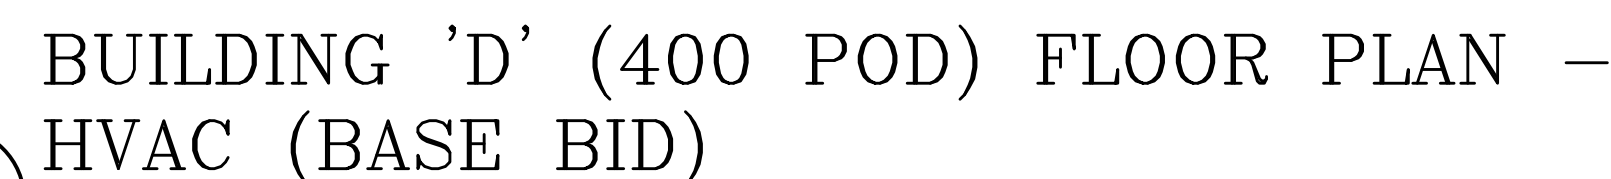

1 HVAC (BAS)
M101 SCALE: 1/8" = 1'-0"

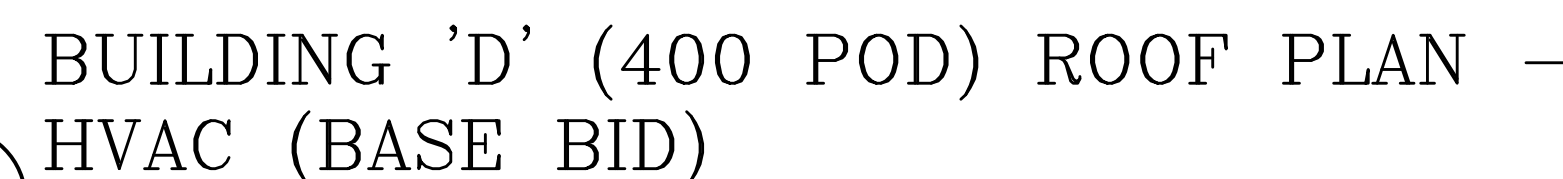


2 HVAC (BAS)
M101 SCALE: 1/8" = 1'-0"



NOT TO SCALE

sims group
CONSULTING ENGINEERS, PC
PO BOX 5534 • ASHEVILLE, NC 28813
PHONE: 828-251-1025 • FAX: 828-251-1933
www.simsgroupconsultingengineers.com
NC FIRM LICENSE #C-4284

derek@simseengineers.com

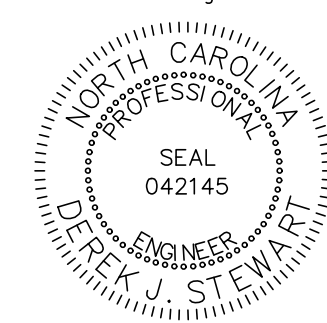

Derek J. Stewart

ATKINSON ELEMENTARY SCHOOL

HVAC CHANGEOUT PHASE I
2510 OLD KANUGA RD. HENDERSONVILLE, NC 28739

DATE: 02/21/24

DESIGN BY: D|S

DRAWN BY: RKH/PAM


APPROVED BY: DIS

SHEET NUMBER:

M101

SCOPE OF WORK NOTES FOR HVAC ALTERNATE BID #1:



1. BASE BID INCLUDES THE REMOVAL AND REPLACEMENT OF THE CURRENT P-TAC STYLE HVAC UNITS IN ALL CLASSROOM AREAS SHOWN ON THIS PLAN.
2. EXISTING CLASSROOM HVAC EQUIPMENT IS TO STAY IN SERVICE UNTIL THE NEW UNITS ARE FULLY FUNCTIONAL.
3. NEW WALL HUNG HVAC UNITS TO BE INSTALLED IN THE CORRIDORS AS SHOWN ABOVE, NO UNITS CURRENTLY IN THIS AREA.
4. FACTORY COMMISSION AND START-UP OF THE UNITS IS MANDATORY.
5. FACTORY INSPECTION AND HANDOVER INSPECTION WITH WRITTEN DOCUMENTATION FROM THE FACTORY AND ALL START UP DOCUMENTATION IS REQUIRED FOR FINAL PAYMENT ON THIS PROJECT.
6. UPON COMPLETION OF THE NEW HVAC SYSTEMS IN EACH CLASSROOM, EXISTING HVAC UNITS SHALL BE REMOVED COMPLETE AND MUST HAVE HOT WATER LINES CAPPED. THE CAPS MUST BE SOLDERED OR PRO-PRESSED, ANY OTHER MEANS OF ISOLATION WILL NOT BE ACCEPTED.
7. EXISTING HVAC UNITS ARE TO BE REMOVED AND STORED ON SITE FOR HENDERSON COUNTY PUBLIC SCHOOLS. ALL RECOVERED R-22 REFRIGERANT WILL BE RETURNED TO HENDERSON COUNTY PUBLIC SCHOOLS. HCPS MAINTENANCE DEPARTMENT WILL PROVIDE THE NEEDED RECOVERY TANKS FOR THE RECOVERED REFRIGERANT.
8. UPON REMOVAL OF THE EXISTING HVAC UNITS, WALL OPENINGS MUST BE SECURED IMMEDIATELY. TEMPORARY COVERS MUST BE WATERTIGHT AND RODENT PROOF UPON LEAVING THE SITE. TEMPORARY COVERS MUST BE SECURED FROM INSIDE THE OF THE BUILDING.
9. THE BASE BID TO INFILL WALL CAVITIES WHERE EXISTING HVAC UNITS ARE REMOVED SHALL BE: 8-INCH BLOCK LAID IN OPENING, WATERPROOFED, FINISHED AND PAINTED TO MATCH THE EXISTING EXTERIOR FINISH. INTERIOR FINISH OF BLOCK TO BE FLUSH WITH EXISTING WALL AND PAINTED TO MATCH THE EXISTING INTERIOR FINISH.
10. ADD-ALTERNATE #5: ALTERNATE BID TO INFILL WALL CAVITIES WHERE EXISTING HVAC UNITS ARE REMOVED SHALL BE: FRAMED 2X6 ON 16 "CENTERS MINIMUM, R-38 INSULATION, AT LEAST 7/16" WEATHER PROOF PLYWOOD WITH A MINIMUM OF A ½" BACKER BOARD WITH STUCCO TO MATCH THE EXISTING EXTERIOR FINISH. INTERIOR FINISH MUST BE FLUSH WITH EXISTING BLOCK WALL, CASED WITH 1X4 LUMBER, AND PAINTED TO MATCH THE EXISTING INTERIOR FINISH.

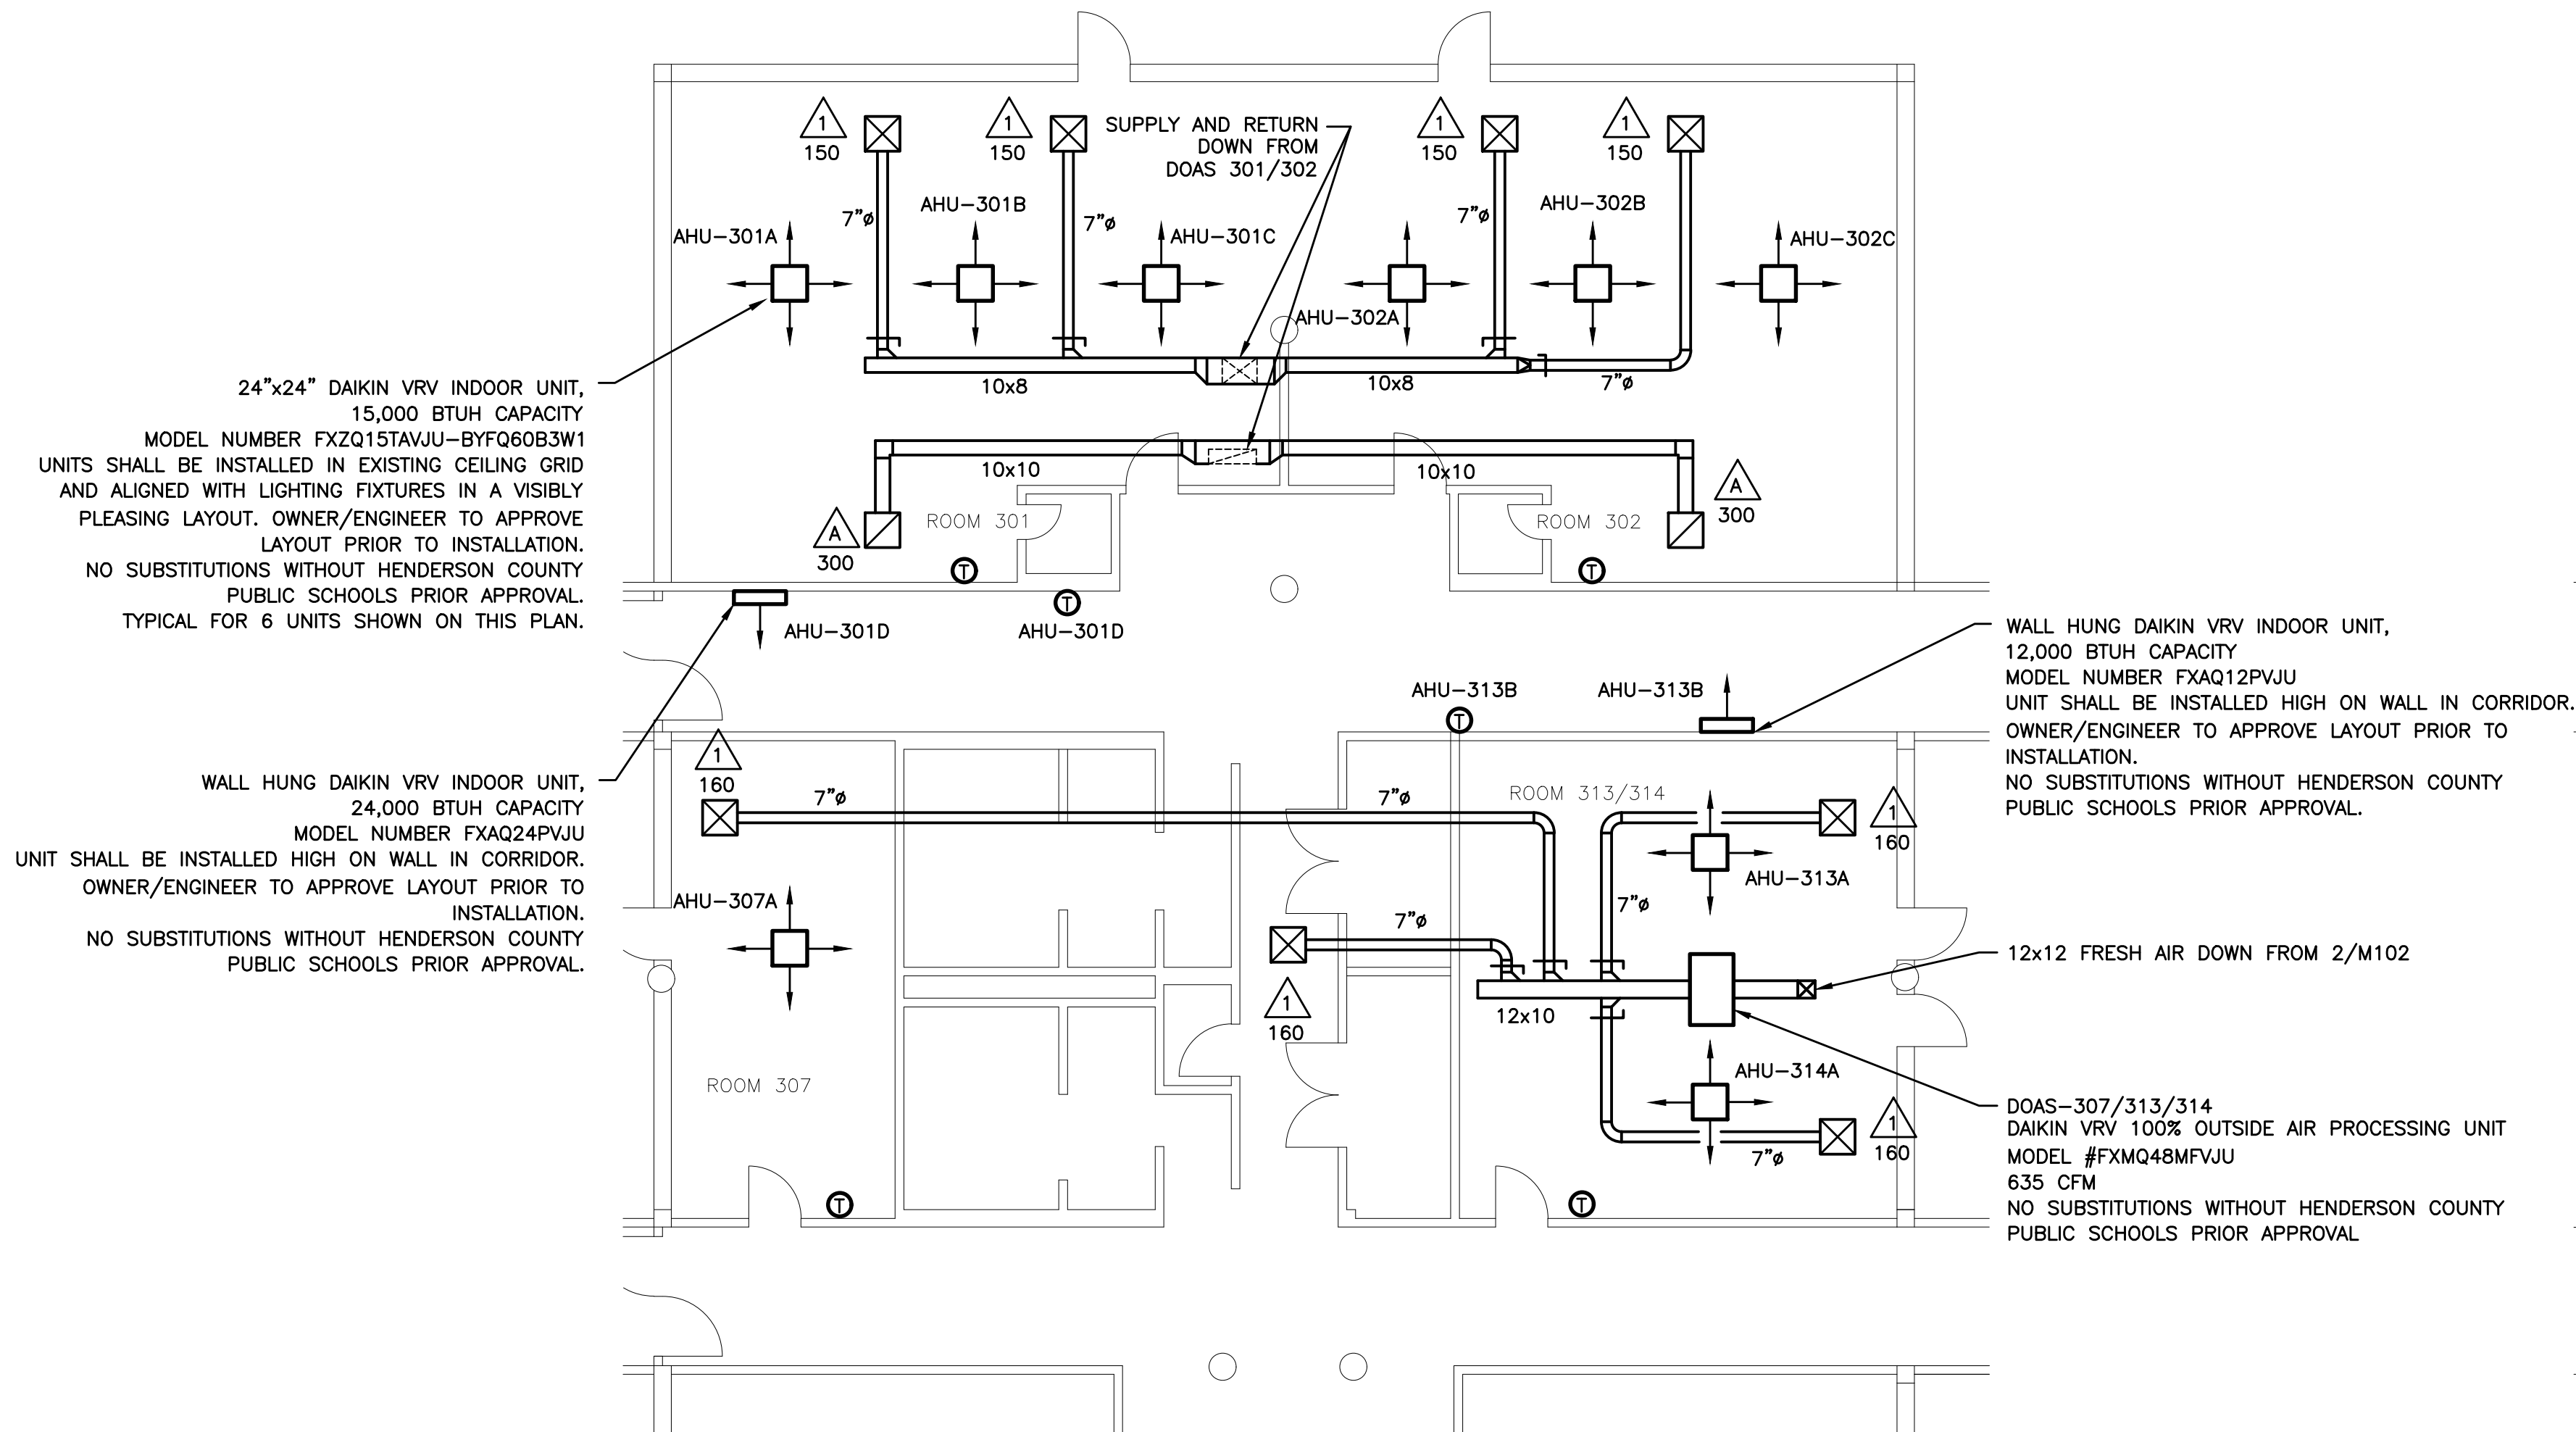

BUILDING 'C' (300 POD) FLOOR PLAN -
HVAC (ALTERNATE BID #1)

1
M102

SCALE: 1/8" = 1'-0"

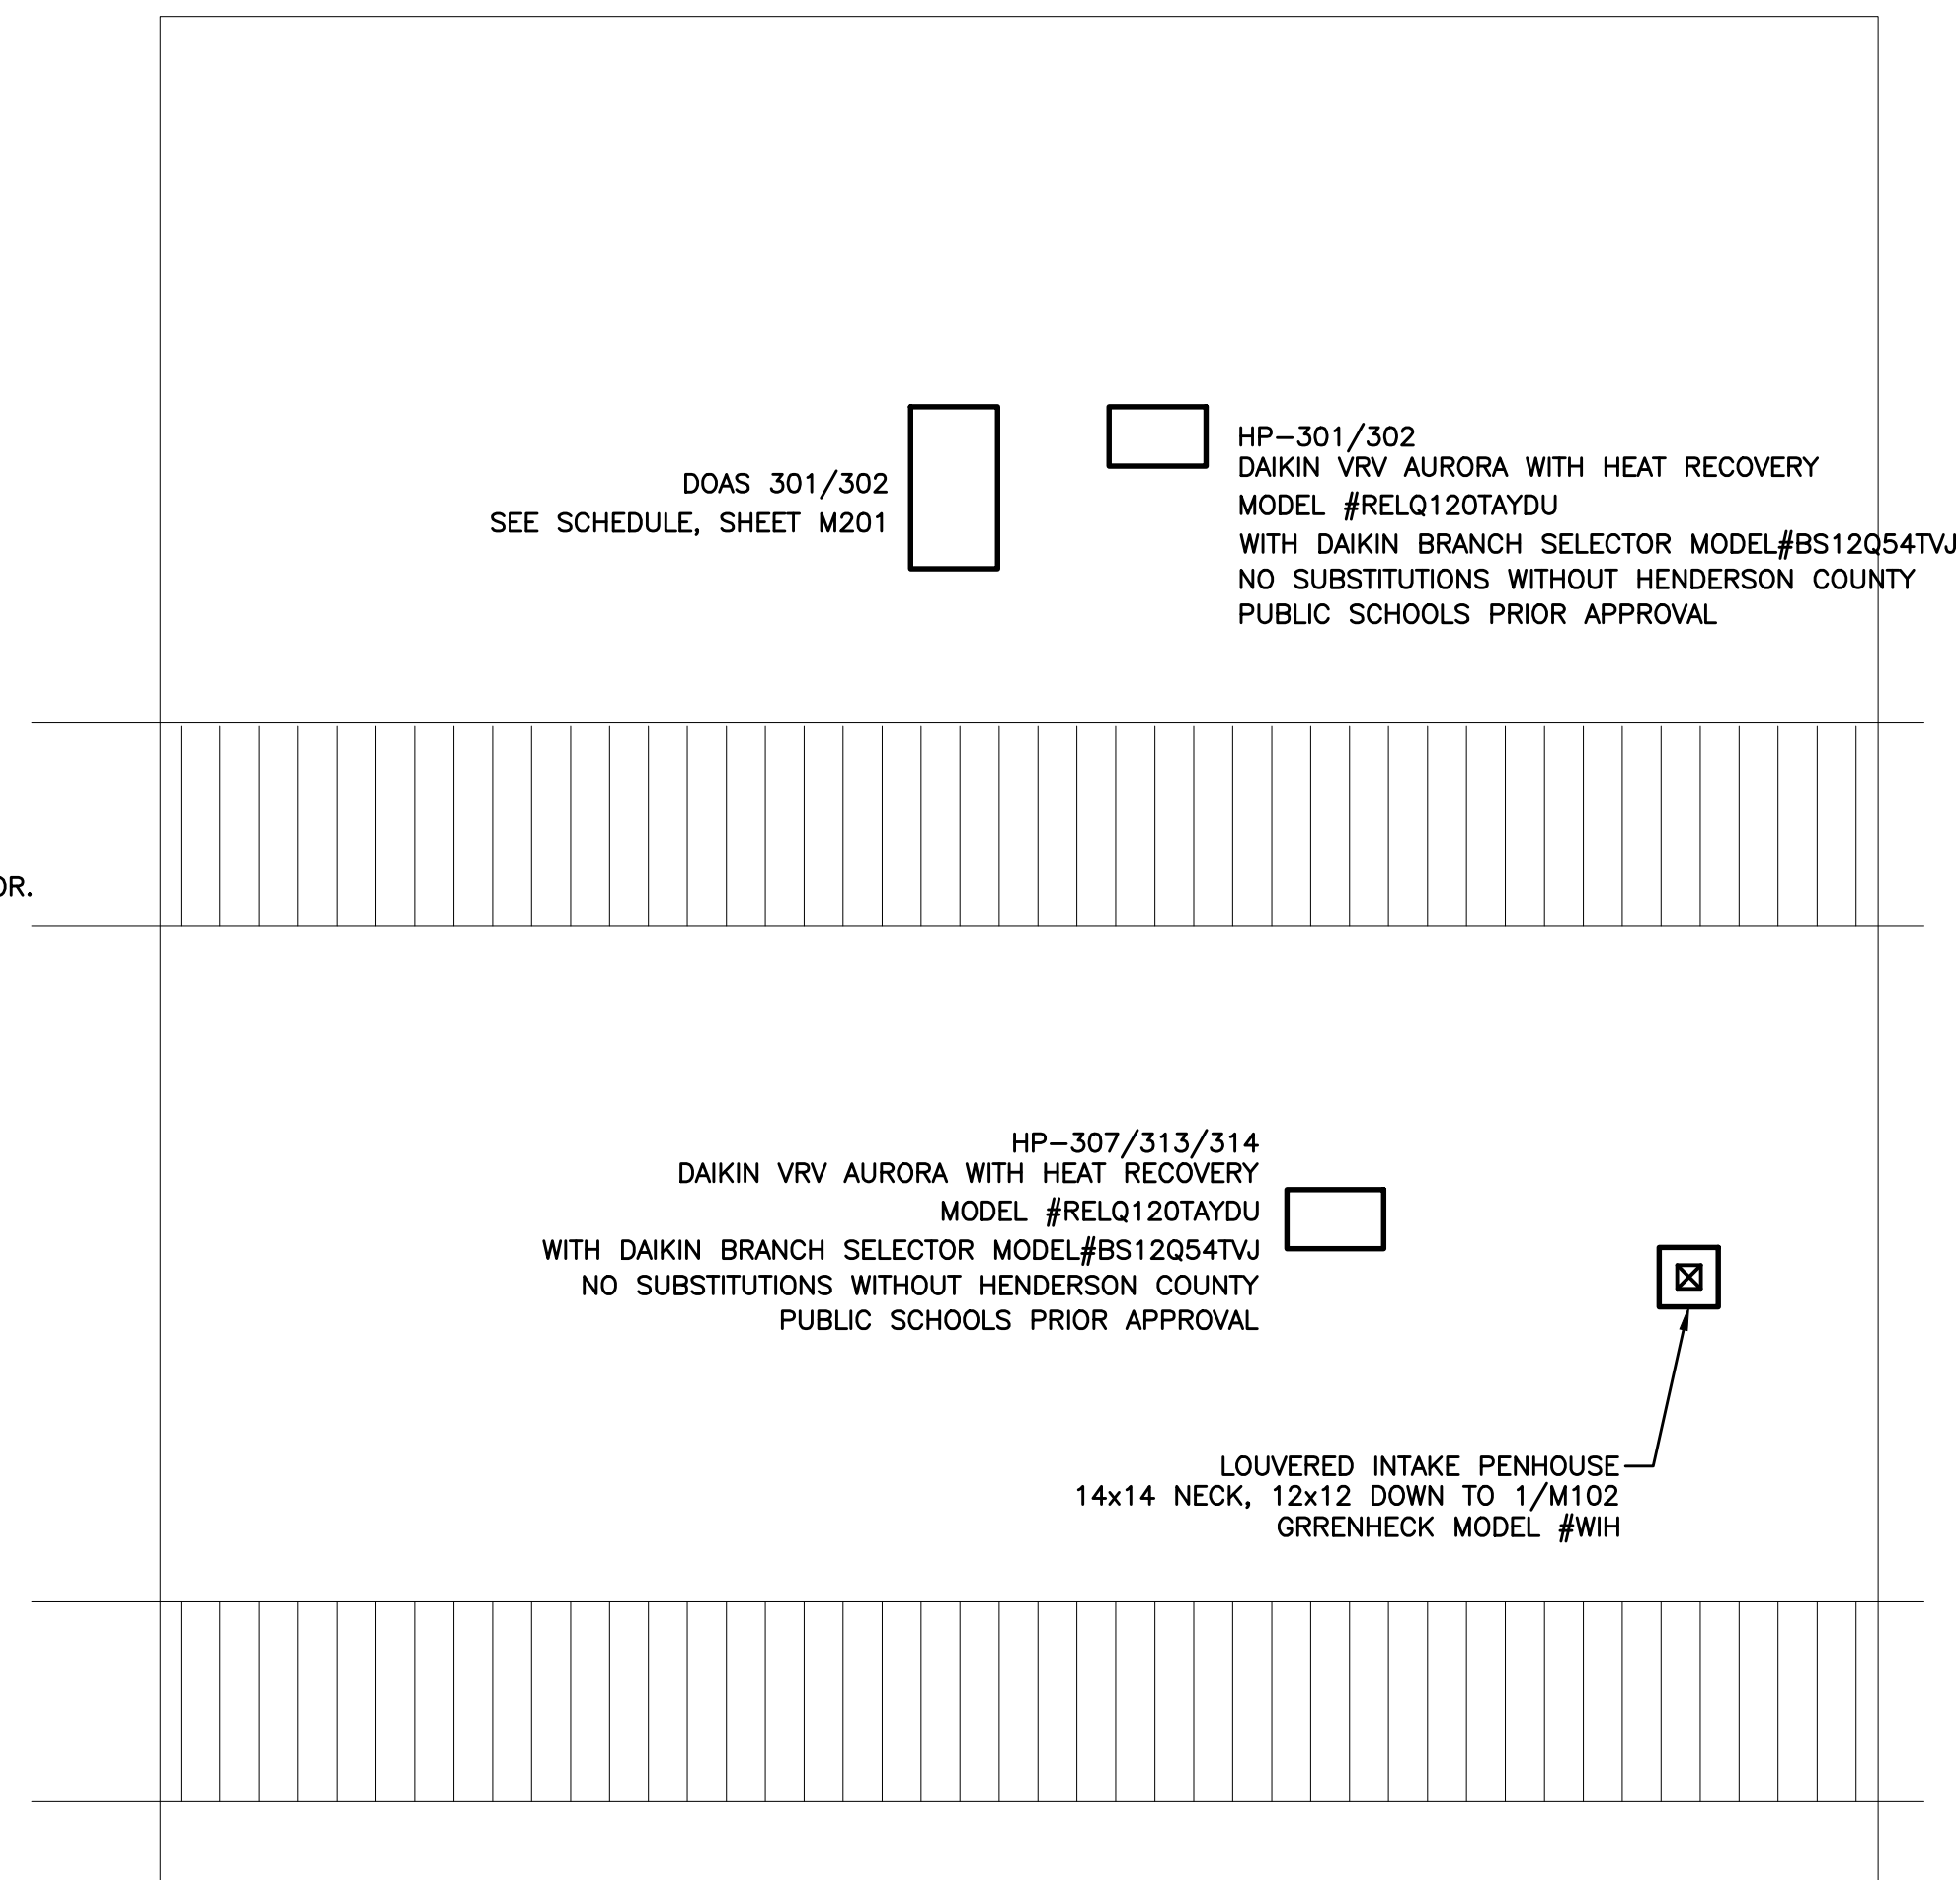
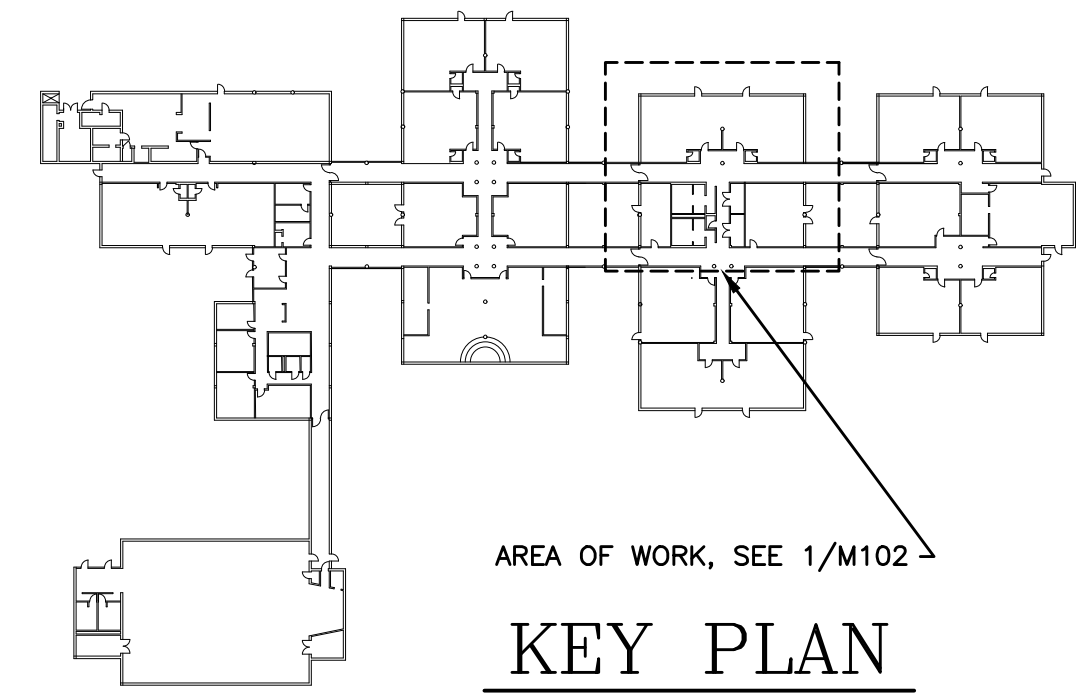


BUILDING 'C' (300 POD) ROOF PLAN -
HVAC (ALTERNATE BID #1)

2
M102

SCALE: 1/8" = 1'-0"

derek@simsengineers.com

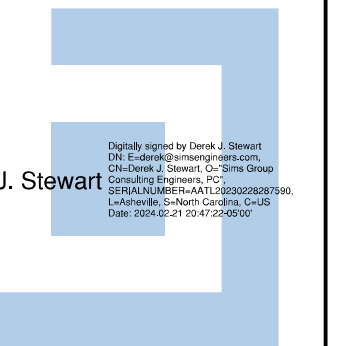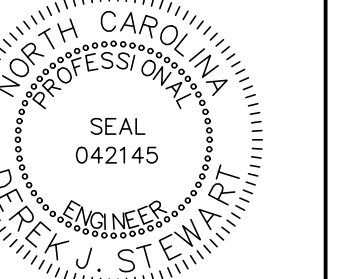

ATKINSON ELEMENTARY SCHOOL

HVAC CHANGEOUT PHASE I
2510 OLD KANUGA RD. HENDERSONVILLE, NC 28739

DATE: 02/21/24

DESIGN BY: DJS

DRAWN BY: RKH/PAM

APPROVED BY: DJS

SHEET NUMBER:


M102

1. BASE BID INCLUDES THE REMOVAL AND REPLACEMENT OF THE CURRENT P-TAC STYLE HVAC UNITS IN ALL CLASSROOM AREAS SHOWN ON THIS PLAN.
2. EXISTING CLASSROOM HVAC EQUIPMENT IS TO STAY IN SERVICE UNTIL THE NEW UNITS ARE FULLY FUNCTIONAL.
3. NEW WALL HUNG HVAC UNITS TO BE INSTALLED IN THE CORRIDORS AS SHOWN ABOVE, NO UNITS CURRENTLY IN THIS AREA.
4. FACTORY COMMISSION AND START-UP OF THE UNIT IS MANDATORY.
5. FACTORY INSPECTION AND HANDOVER INSPECTION WITH WRITTEN DOCUMENTATION FROM THE FACTORY AND ALL START UP DOCUMENTATION IS REQUIRED FOR FINAL PAYMENT ON THIS PROJECT.
6. UPON COMPLETION OF THE NEW HVAC SYSTEMS IN EACH CLASSROOM, EXISTING HVAC UNITS SHALL BE REMOVED COMPLETE AND MUST HAVE HOT WATER LINES CAPPED. THE CAPS MUST BE SOLDERED OR PRO-PRESSED, ANY OTHER MEANS OF ISOLATION WILL NOT BE ACCEPTED.
7. ALL REMOVED HVAC UNITS AND SUPPLIES ARE TO BE STORED ON SITE FOR HENDERSON COUNTY PUBLIC SCHOOLS. ALL RECOVERED R-22 REFRIGERANT WILL BE RETURNED TO HENDERSON COUNTY PUBLIC SCHOOLS. HCPS MAINTENANCE DEPARTMENT WILL PROVIDE THE NEEDED RECOVERY TANKS FOR THE RECOVERED REFRIGERANT.
8. UPON REMOVAL OF THE EXISTING HVAC UNITS, WALL OPENINGS MUST BE SECURED IMMEDIATELY. TEMPORARY COVERS MUST BE WATER TIGHT AND RODENT PROOF UPON LEAVING THE SITE. TEMPORARY COVERS MUST BE SECURED FROM INSIDE THE OF THE BUILDING.
9. BASE BID TO PATCH ALL CAVITIES WHERE EXISTING HVAC UNITS ARE REMOVED SHALL BE: 8-INCH BLOCK LAID IN OPENING, WATERPROOFED, FINISHED AND PAINTED TO MATCH THE EXISTING EXTERIOR FINISH. INTERIOR FINISH OF BLOCK TO BE FLUSH WITH EXISTING WALL AND PAINTED TO MATCH THE EXISTING INTERIOR FINISH.
10. ADD-ALTERATION #5: ALTERNATE BID TO INFILL WALL CAVITIES WHERE EXISTING HVAC UNITS ARE REMOVED SHALL BE: EXISTED 2X6 ON 16 "CENTERS MINIMUM, R-38 INSULATION, AT LEAST 7/16" WEATHER PROOF PLYWOOD WITH A MINIMUM OF A 1/2" BACKER BOARD WITH STUCCO TO MATCH THE EXISTING EXTERIOR FINISH. INTERIOR FINISH MUST BE FLUSH WITH EXISTING BLOCK WALL, CASED WITH 1X4 LUMBER, AND PAINTED TO MATCH THE EXISTING INTERIOR FINISH.



KEY PLAN


NOT TO SCALE

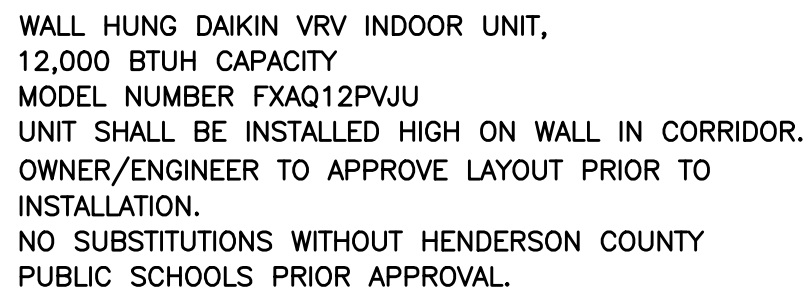

WALL HUNG DAIKIN VRV INDOOR UNIT,
24,000 BTUH CAPACITY
MODEL NUMBER FXAQ24PVJU
UNIT SHALL BE INSTALLED HIGH ON WALL IN CORRIDOR.
OWNER/ENGINEER TO APPROVE LAYOUT PRIOR TO
INSTALLATION.
NO SUBSTITUTIONS WITHOUT HENDERSON COUNTY
PUBLIC SCHOOLS PRIOR APPROVAL.

1
M103

SCALE: $1/8" = 1'-0"$




SEE SCHEDULE, SHEET

HP-318/318
DAIKIN VRV AURORA WITH HEAT RECOVERY
MODEL #RELQ120TAYDU
WITH DAIKIN BRANCH SELECTOR MODEL#BS12Q54TV.
NO SUBSTITUTIONS WITHOUT HENDERSON COUNTY
PUBLIC SCHOOLS PRIOR APPROVAL

DOAS 320/321


SEE SCHEDULE, SHEET M201

HP-320/321
DAIKIN VRV AURORA WITH HEAT RECOVERY
MODEL #RELQ120TAYDU
WITH DAIKIN BRANCH SELECTOR MODEL#BS12Q54TVJ
NO SUBSTITUTIONS WITHOUT HENDERSON COUNTY
PUBLIC SCHOOLS PRIOR APPROVAL



SCALE: $1/8" = 1'-0"$

erek@simsengineers.com

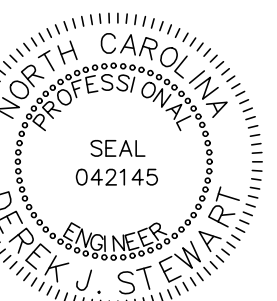

Derek J. Stewart
CA/Design J. Stewart, Q/Team Group
Consulting Engineers, PC
3850 N. 11th St., Suite 100, Raleigh, NC 27601
Tel: 919/876-1111, Fax: 919/876-1112, E-Mail: djs@stewartjones.com

ATKINSON ELEMENTARY SCHOOL

HVAC CHANGEOUT PHASE I
2510 OLD KANUGA RD. HENDERSONVILLE, NC 28739

DATE: 02/21/24

DESIGN BY: DJS


DRAWN BY: RKH/PAM

APPROVED BY: DJS

SHEET NUMBER:

M103


- SCOPE OF WORK NOTES FOR HVAC ALTERNATE BID #3:
1. BASE BID INCLUDES THE REMOVAL AND REPLACEMENT OF THE CURRENT P-TAC STYLE HVAC UNITS IN THE MEDIA CENTER AREA SHOWN ABOVE.
 2. EXISTING MEDIA CENTER HVAC EQUIPMENT IS TO STAY IN SERVICE UNTIL THE NEW UNITS ARE FULLY FUNCTIONAL.
 3. FACTORY COMMISSION AND START-UP OF THE UNITS IS MANDATORY.
 4. FACTORY INSPECTION AND HANDOVER INSPECTION WITH WRITTEN DOCUMENTATION FROM THE FACTORY AND ALL START UP DOCUMENTATION IS REQUIRED FOR FINAL PAYMENT ON THIS PROJECT.
 5. UPON COMPLETION OF THE NEW HVAC SYSTEMS IN THE MEDIA CENTER, EXISTING HVAC UNITS SHALL BE REMOVED COMPLETE AND MUST HAVE HOT WATER LINES CAPPED. THE CAPS MUST BE SOLDERED OR PRO-PRESSED, ANY OTHER MEANS OF ISOLATION WILL NOT BE ACCEPTED.
 6. EXISTING HVAC UNITS ARE TO BE REMOVED AND STORED ON SITE FOR HENDERSON COUNTY PUBLIC SCHOOLS. ALL RECOVERED R-22 REFRIGERANT WILL BE RETURNED TO HENDERSON COUNTY PUBLIC SCHOOLS. HCPS MAINTENANCE DEPARTMENT WILL PROVIDE THE NEEDED RECOVERY TANKS FOR THE RECOVERED REFRIGERANT.
 7. UPON REMOVAL OF THE EXISTING HVAC UNITS, WALL OPENINGS MUST BE SECURED IMMEDIATELY. TEMPORARY COVERS MUST BE WATERTIGHT AND RODENT PROOF UPON LEAVING THE SITE. TEMPORARY COVERS MUST BE SECURED FROM INSIDE THE OF THE BUILDING.
 8. THE BASE BID TO INFILL WALL CAVITIES WHERE EXISTING HVAC UNITS ARE REMOVED SHALL BE: 8-INCH BLOCK LAID IN OPENING, WATERPROOFED, FINISHED AND PAINTED TO MATCH THE EXISTING EXTERIOR FINISH. INTERIOR FINISH OF BLOCK TO BE FLUSH WITH EXISTING WALL AND PAINTED TO MATCH THE EXISTING INTERIOR FINISH.
 9. ADD-ALTERNATE #5: ALTERNATE BID TO INFILL WALL CAVITIES WHERE EXISTING HVAC UNITS ARE REMOVED SHALL BE: FRAMED 2X6 ON 16 "CENTERS MINIMUM, R-38 INSULATION, AT LEAST 7/16" WEATHER PROOF PLYWOOD WITH A MINIMUM OF A ½" BACKER BOARD WITH STUCCO TO MATCH THE EXISTING EXTERIOR FINISH. INTERIOR FINISH MUST BE FLUSH WITH EXISTING BLOCK WALL, CASED WITH 1X4 LUMBER, AND PAINTED TO MATCH THE EXISTING INTERIOR FINISH.

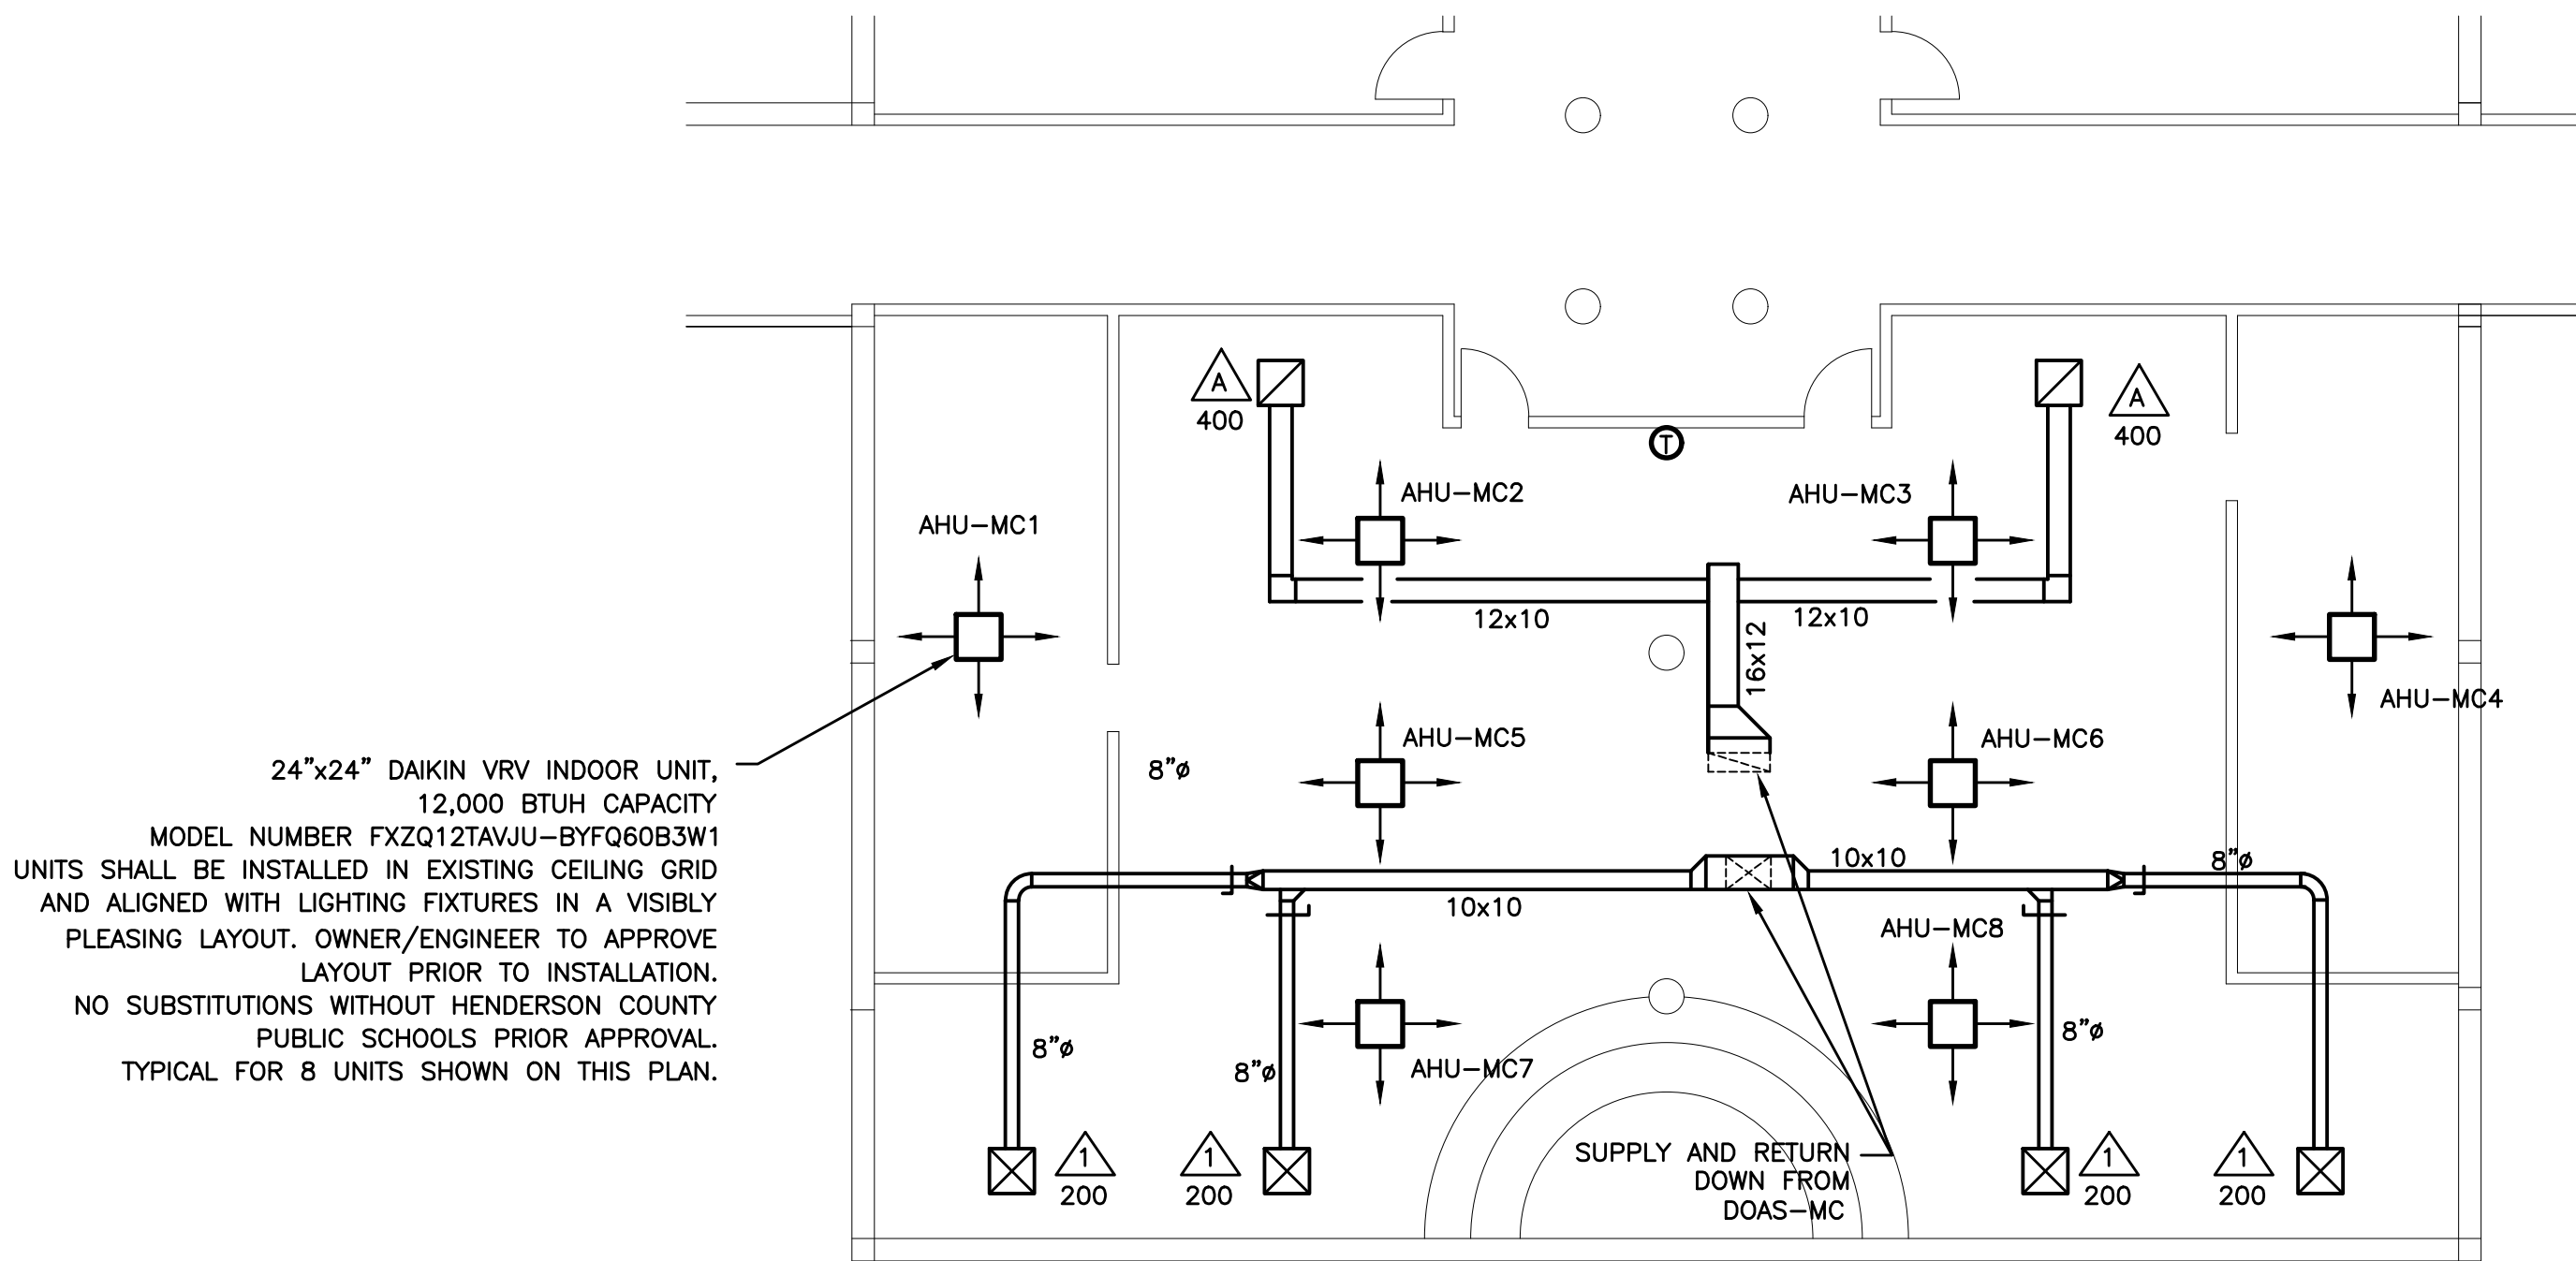

MEDIA CENTER FLOOR PLAN –
HVAC (ALTERNATE BID #3)

1
M104


SCALE: 1/8" = 1'-0"

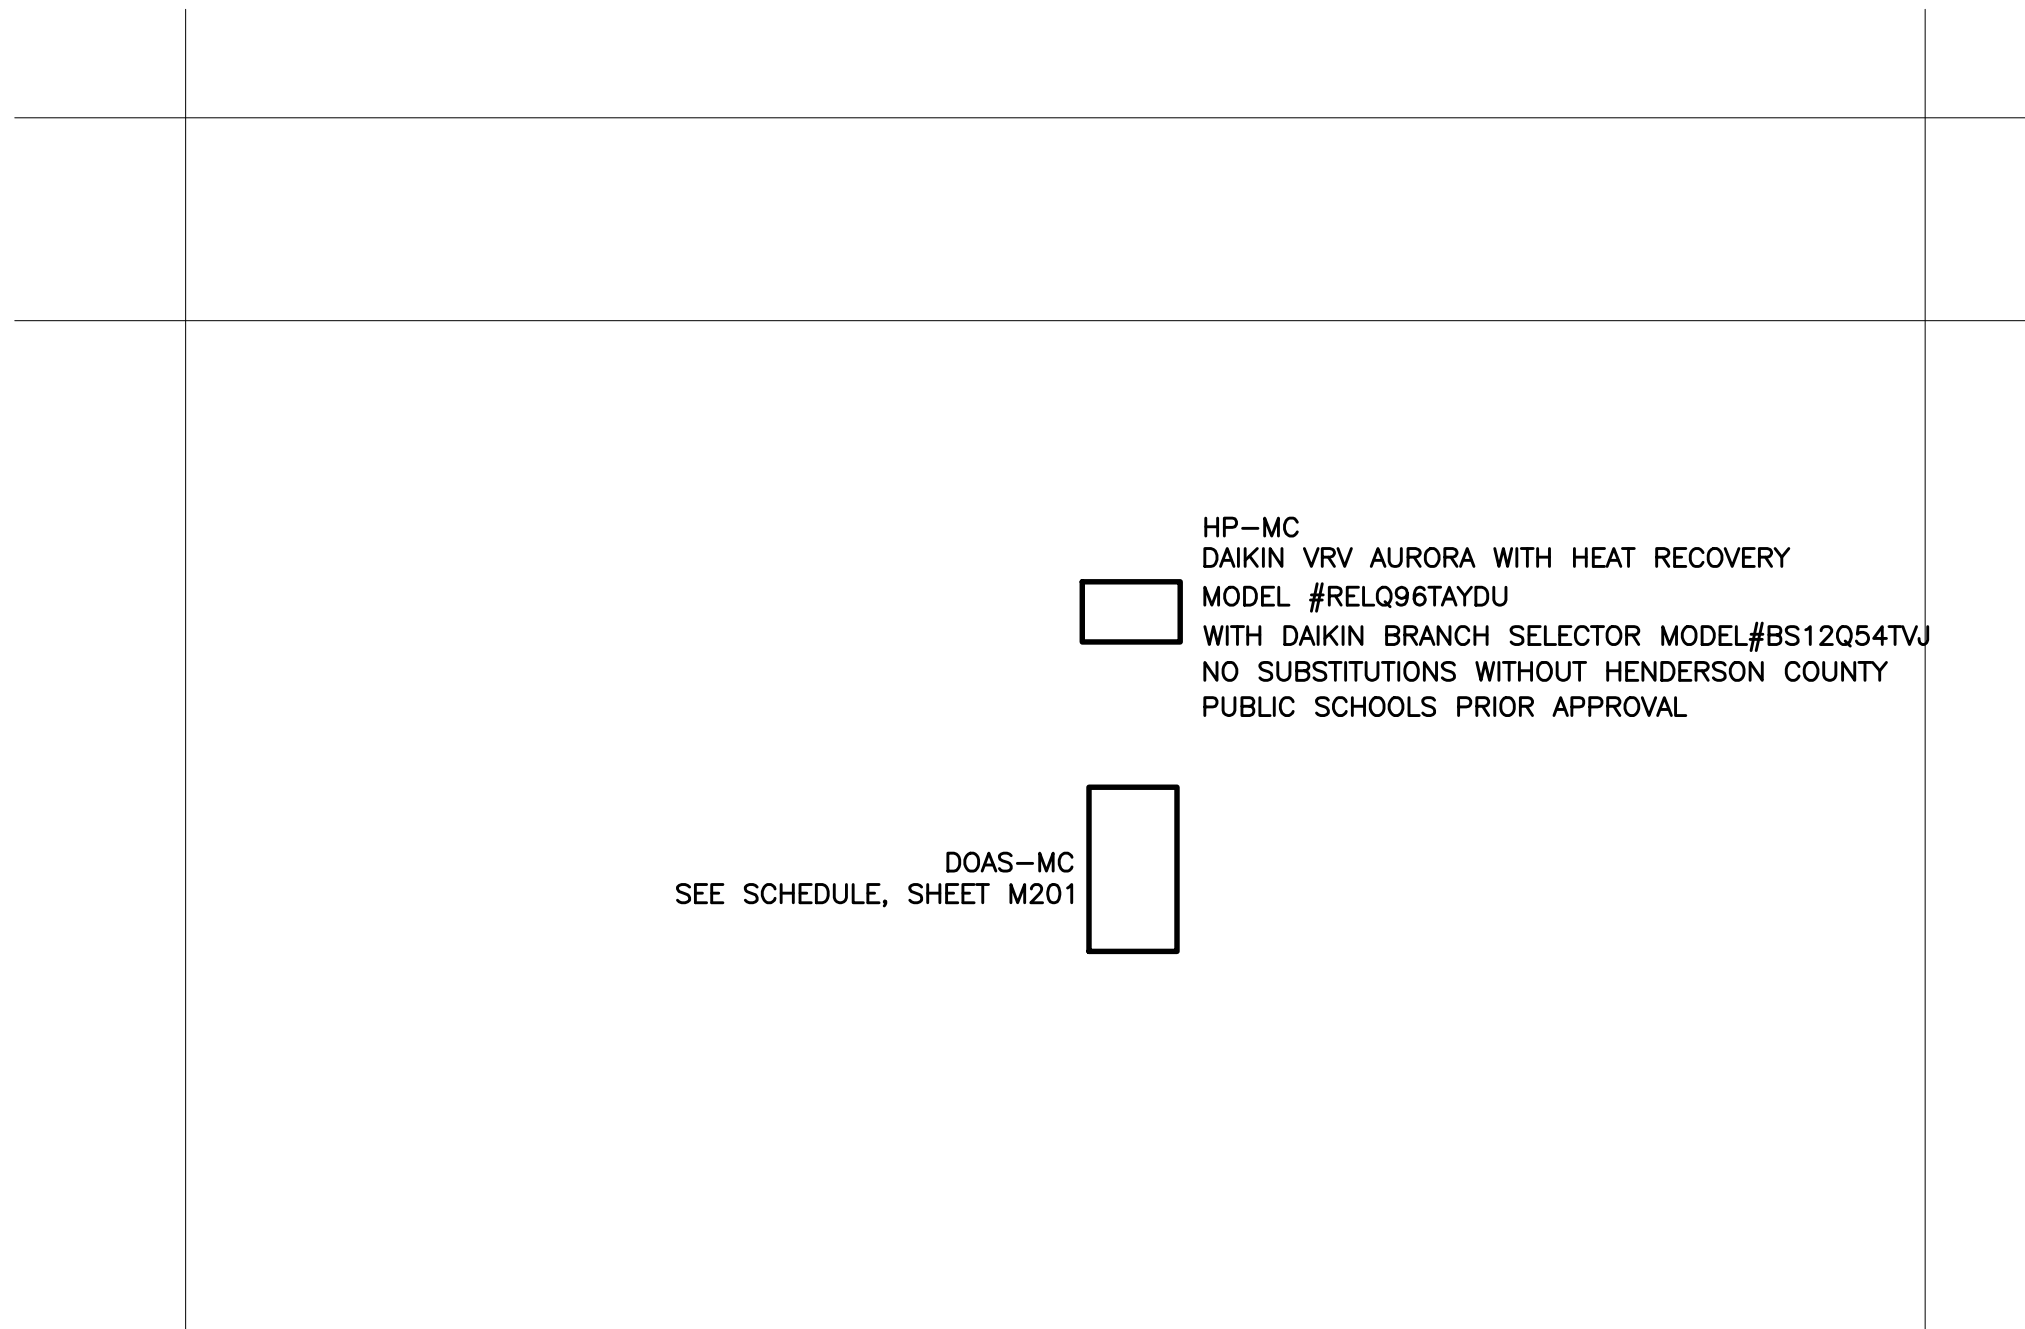


MEDIA CENTER ROOF PLAN –
HVAC (ALTERNATE BID #3)

1
M104

SCALE: 1/8" = 1'-0"

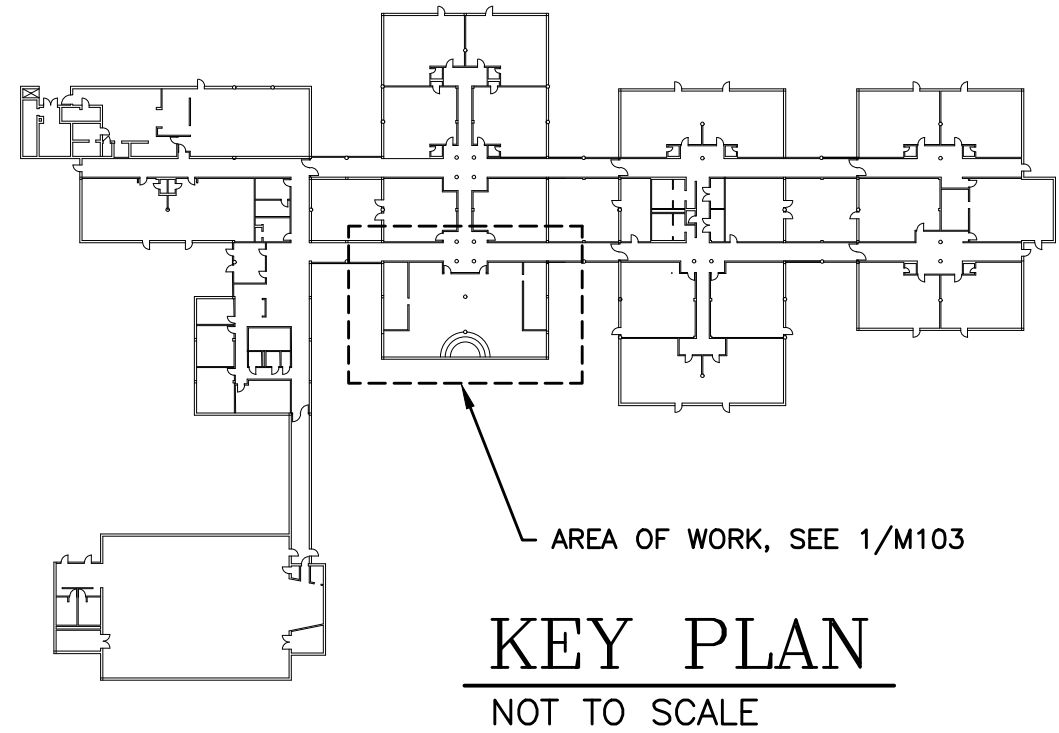

sims group
CONSULTING ENGINEERS, PC
PO BOX 5534 • ASHEVILLE, NC 28813
PHONE: 828-251-2025 • FAX: 828-251-1933
www.simgroupconsultingengineers.com
NORTH CAROLINA LICENSE #2884
IT MAY NOT BE REPRODUCED OR USED IN ANY MANNER WITHOUT PERMISSION."

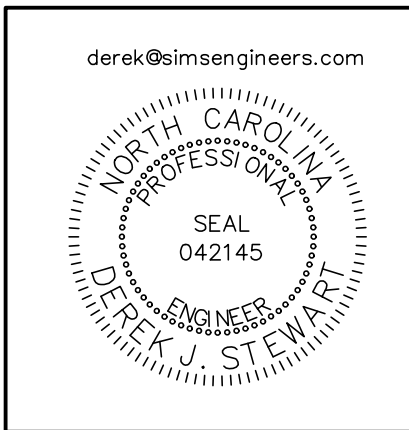

ATKINSON ELEMENTARY SCHOOL
HVAC CHANGEOUT PHASE I
2510 OLD KANIUGA RD. HENDERSONVILLE, NC 28739

DATE: 02/21/24

DESIGN BY: DJS

DRAWN BY: RKH/PAW

APPROVED BY: DJS

SHEET NUMBER:











M104

DEDICATED OUTDOOR AIR SYSTEM EQUIPMENT SCHEDULE										
UNIT NO.	CFM		COOLING CAPACITY	COOLING PERFORMANCE	HEATING CAPACITY	HEATING PERFORMANCE	POWER REQUIREMENTS			DESCRIPTION
	SUPPLY/ OA	RETURN/ EXHAUST	TOTAL/ SENSIBLE	EAT °F/LAT °F (REHEAT BTUH)	INPUT/OUTPUT	EAT °F/LAT °F	MCA	MOP	VOLTS /ø	
BASE BID: DOAS-401/402 DOAS-403/404 DOAS-405/406	600	600	50,900 BTUH/ 28,600 BTUH	EAT: 86/71 LAT: 48.2/48.1 (20,100)	68,600 BTUH/ 55,500 BTUH	EAT: 11 LAT: 103.8	12	15	480/3	GREENHECK MODEL RV-10-3-1 PROVIDE WITH BACNET CONTROLLER COMPATIBLE WITH HENDERSON COUNTY PUBLIC SCHOOLS OPEN SOURCE BACNET
ALTERNATE #1 DOAS-301/302	600	600	50,900 BTUH/ 28,600 BTUH		68,600 BTUH/ 55,500 BTUH	EAT: 11 LAT: 103.8	12	15	480/3	GREENHECK MODEL RV-10-3-1 PROVIDE WITH BACNET CONTROLLER COMPATIBLE WITH HENDERSON COUNTY PUBLIC SCHOOLS OPEN SOURCE BACNET
ALTERNATE #2 DOAS-318/319 DOAS-320/321	600	600	50,900 BTUH/ 28,600 BTUH		68,600 BTUH/ 55,500 BTUH	EAT: 11 LAT: 103.8	12	15	480/3	GREENHECK MODEL RV-10-3-1 PROVIDE WITH BACNET CONTROLLER COMPATIBLE WITH HENDERSON COUNTY PUBLIC SCHOOLS OPEN SOURCE BACNET
ALTERNATE #3 DOAS-MC	800	800	50,900 BTUH/ 28,600 BTUH	EAT: 86/71 LAT: 50.1/49.9 (24,700)	68,600 BTUH/ 55,500 BTUH	EAT: 11 LAT: 80.6	12	15	480/3	GREENHECK MODEL RV-10-4-1 PROVIDE WITH BACNET CONTROLLER COMPATIBLE WITH HENDERSON COUNTY PUBLIC SCHOOLS OPEN SOURCE BACNET

NOTES:
1. NO EQUIPMENT SUBSTITUTIONS WITHOUT HENDERSON COUNTY PUBLIC SCHOOLS PRIOR APPROVAL


SUPPLY DIFFUSER SCHEDULE		
MARK	THROAT	DESCRIPTION
1	6x6	LOUVER FACE, STEEL, 4-WAY, OPPOSED BLADE DAMPER, BAKED OFF-WHITE FINISH, NAILOR 6500
2	9x9	
3	12x12	
4	15x15	
5	15x15	

RETURN REGISTER SCHEDULE		
MARK	THROAT	DESCRIPTION
A	22x22	1/2x1/2x1 CUBE LOUVER, ALUMINUM WITH FRAME, LAYIN, OPPOSED BLADE DAMPER, BAKED OFF-WHITE FINISH, NAILOR 4260AA


HVAC LEGEND	
MARK	DESCRIPTION
 350	DIFFUSER,  DENOTES TYPE (SEE SCHEDULE) "350" DENOTES CFM, MAY USE FIVE FEET OF FLEX DUCT TO CONNECT TO TRUNK
 350	RETURN REGISTER,  DENOTES TYPE (SEE SCHEDULE), "350" DENOTES CFM
	WALL MOUNTED DAIKIN SIMPLIFIED REMOTE CONTROLLER TO BE CONTROLLED BY DAIKIN INTELLIGENT TOUCH MANAGER INTELLIGENT TOUCH MANAGER TO BE LOCATED IN BOILER ROOM WITH EXISTING BUILDING CONTROLS SYSTEM AND PROVIDED WITH OPEN SOURCE BACNET CONTROLLER
 12x6	RECTANGULAR DUCTWORK, GALVANIZED; "12" DENOTES WIDTH, "6" DENOTES DEPTH. DIMENSIONS SHOWN ARE FREE AND CLEAR.
 12"ø SPIRAL	SPIRAL WOUND DOUBLE WALL INSULATED DUCT, UNILOCK JOINTS, PAINT GRIP FINISH. MANUFACTURER'S FITINGS.
 12"ø	DUCTWORK, ROUND, GALVANIZED
	DUCT TEE, BEND, ELBOW, RADIUS NOT LESS 1.5 C/L WIDTH OR PROVIDE RECTANGULAR ELBOWS WITH AIR FOIL TURNING VANES.
	SPLITTER DAMPER

sims group
CONSULTING ENGINEERS, PC
PO BOX 5534 • ASHEVILLE, NC 28813
PHONE: 828-251-1933 • FAX: 828-251-1933
www.simsengineers.com
N.C. LICENSE # 2284
IT MAY NOT BE REPRODUCED OR USED IN ANY MANNER WITHOUT PERMISSION.

derek@simsengineers.com



Derek J. Stewart



Derek J. Stewart

ATKINSON ELEMENTARY SCHOOL

HVAC CHANGEOUT PHASE I


2510 OLD KANUGA RD. HENDERSONVILLE, NC 28739

DATE:	02/21/24
DESIGN BY:	DJS
DRAWN BY:	RKH/PAM
APPROVED BY:	DJS
SHEET NUMBER:	

M201

SCOPE OF WORK NOTES FOR ELECTRICAL BASE BID:

1. BASE BID INCLUDES THE REMOVAL AND REPLACEMENT OF THE CURRENT P-TAC STYLE HVAC UNITS IN ALL CLASSROOM AREAS SHOWN ON THIS PLAN.
2. EXISTING CLASSROOM HVAC EQUIPMENT IS TO STAY IN SERVICE UNTIL THE NEW UNITS ARE FULLY FUNCTIONAL.
3. NEW WALL HUNG HVAC UNITS TO BE INSTALLED IN THE CORRIDORS AS SHOWN ABOVE, NO UNITS CURRENTLY IN THIS AREA.
4. FACTORY COMMISSION AND START-UP OF THE UNITS IS MANDATORY.
5. FACTORY INSPECTION AND HANDOVER INSPECTION WITH WRITTEN DOCUMENTATION FROM THE FACTORY AND ALL START UP DOCUMENTATION IS REQUIRED FOR FINAL PAYMENT ON THIS PROJECT.
6. UPON COMPLETION OF THE NEW HVAC SYSTEMS IN EACH CLASSROOM, EXISTING HVAC UNIT BRANCH CIRCUITS ARE TO BE REMOVED TO THE PANEL AND REPLACED PER INSTRUCTIONS ON THIS SHEET.
7. ADD-ALTERNATE #4 SHALL BE TO REPLACE EXISTING PANELS SERVING HVAC UNITS IN THIS AREA WITH NEW PANELS ON A 1:1 BASIS.
8. UPON REMOVAL OF THE EXISTING HVAC UNITS, WALL OPENINGS MUST BE SECURED IMMEDIATELY. TEMPORARY COVERS MUST BE WATERTIGHT AND RODENT PROOF UPON LEAVING THE SITE. TEMPORARY COVERS MUST BE SECURED FROM INSIDE THE OF THE BUILDING.
9. THE BASE BID TO INFILL WALL CAVITIES WHERE EXISTING HVAC UNITS ARE REMOVED SHALL BE: 8-INCH BLOCK LAID IN OPENING, WATERPROOFED, FINISHED AND PAINTED TO MATCH THE EXISTING EXTERIOR FINISH. INTERIOR FINISH OF BLOCK TO BE FLUSH WITH EXISTING WALL AND PAINTED TO MATCH THE EXISTING INTERIOR FINISH.
10. ADD-ALTERNATE #5: ALTERNATE BID TO INFILL WALL CAVITIES WHERE EXISTING HVAC UNITS ARE REMOVED SHALL BE: FRAMED 2X6 ON 16 "CENTERS MINIMUM, R-38 INSULATION, AT LEAST 7/16"WEATHER PROOF PLYWOOD WITH A MINIMUM OF A ½" BACKER BOARD WITH STUCCO TO MATCH THE EXISTING EXTERIOR FINISH. INTERIOR FINISH MUST BE FLUSH WITH EXISTING BLOCK WALL, CASED WITH 1X4 LUMBER, AND PAINTED TO MATCH THE EXISTING INTERIOR FINISH.

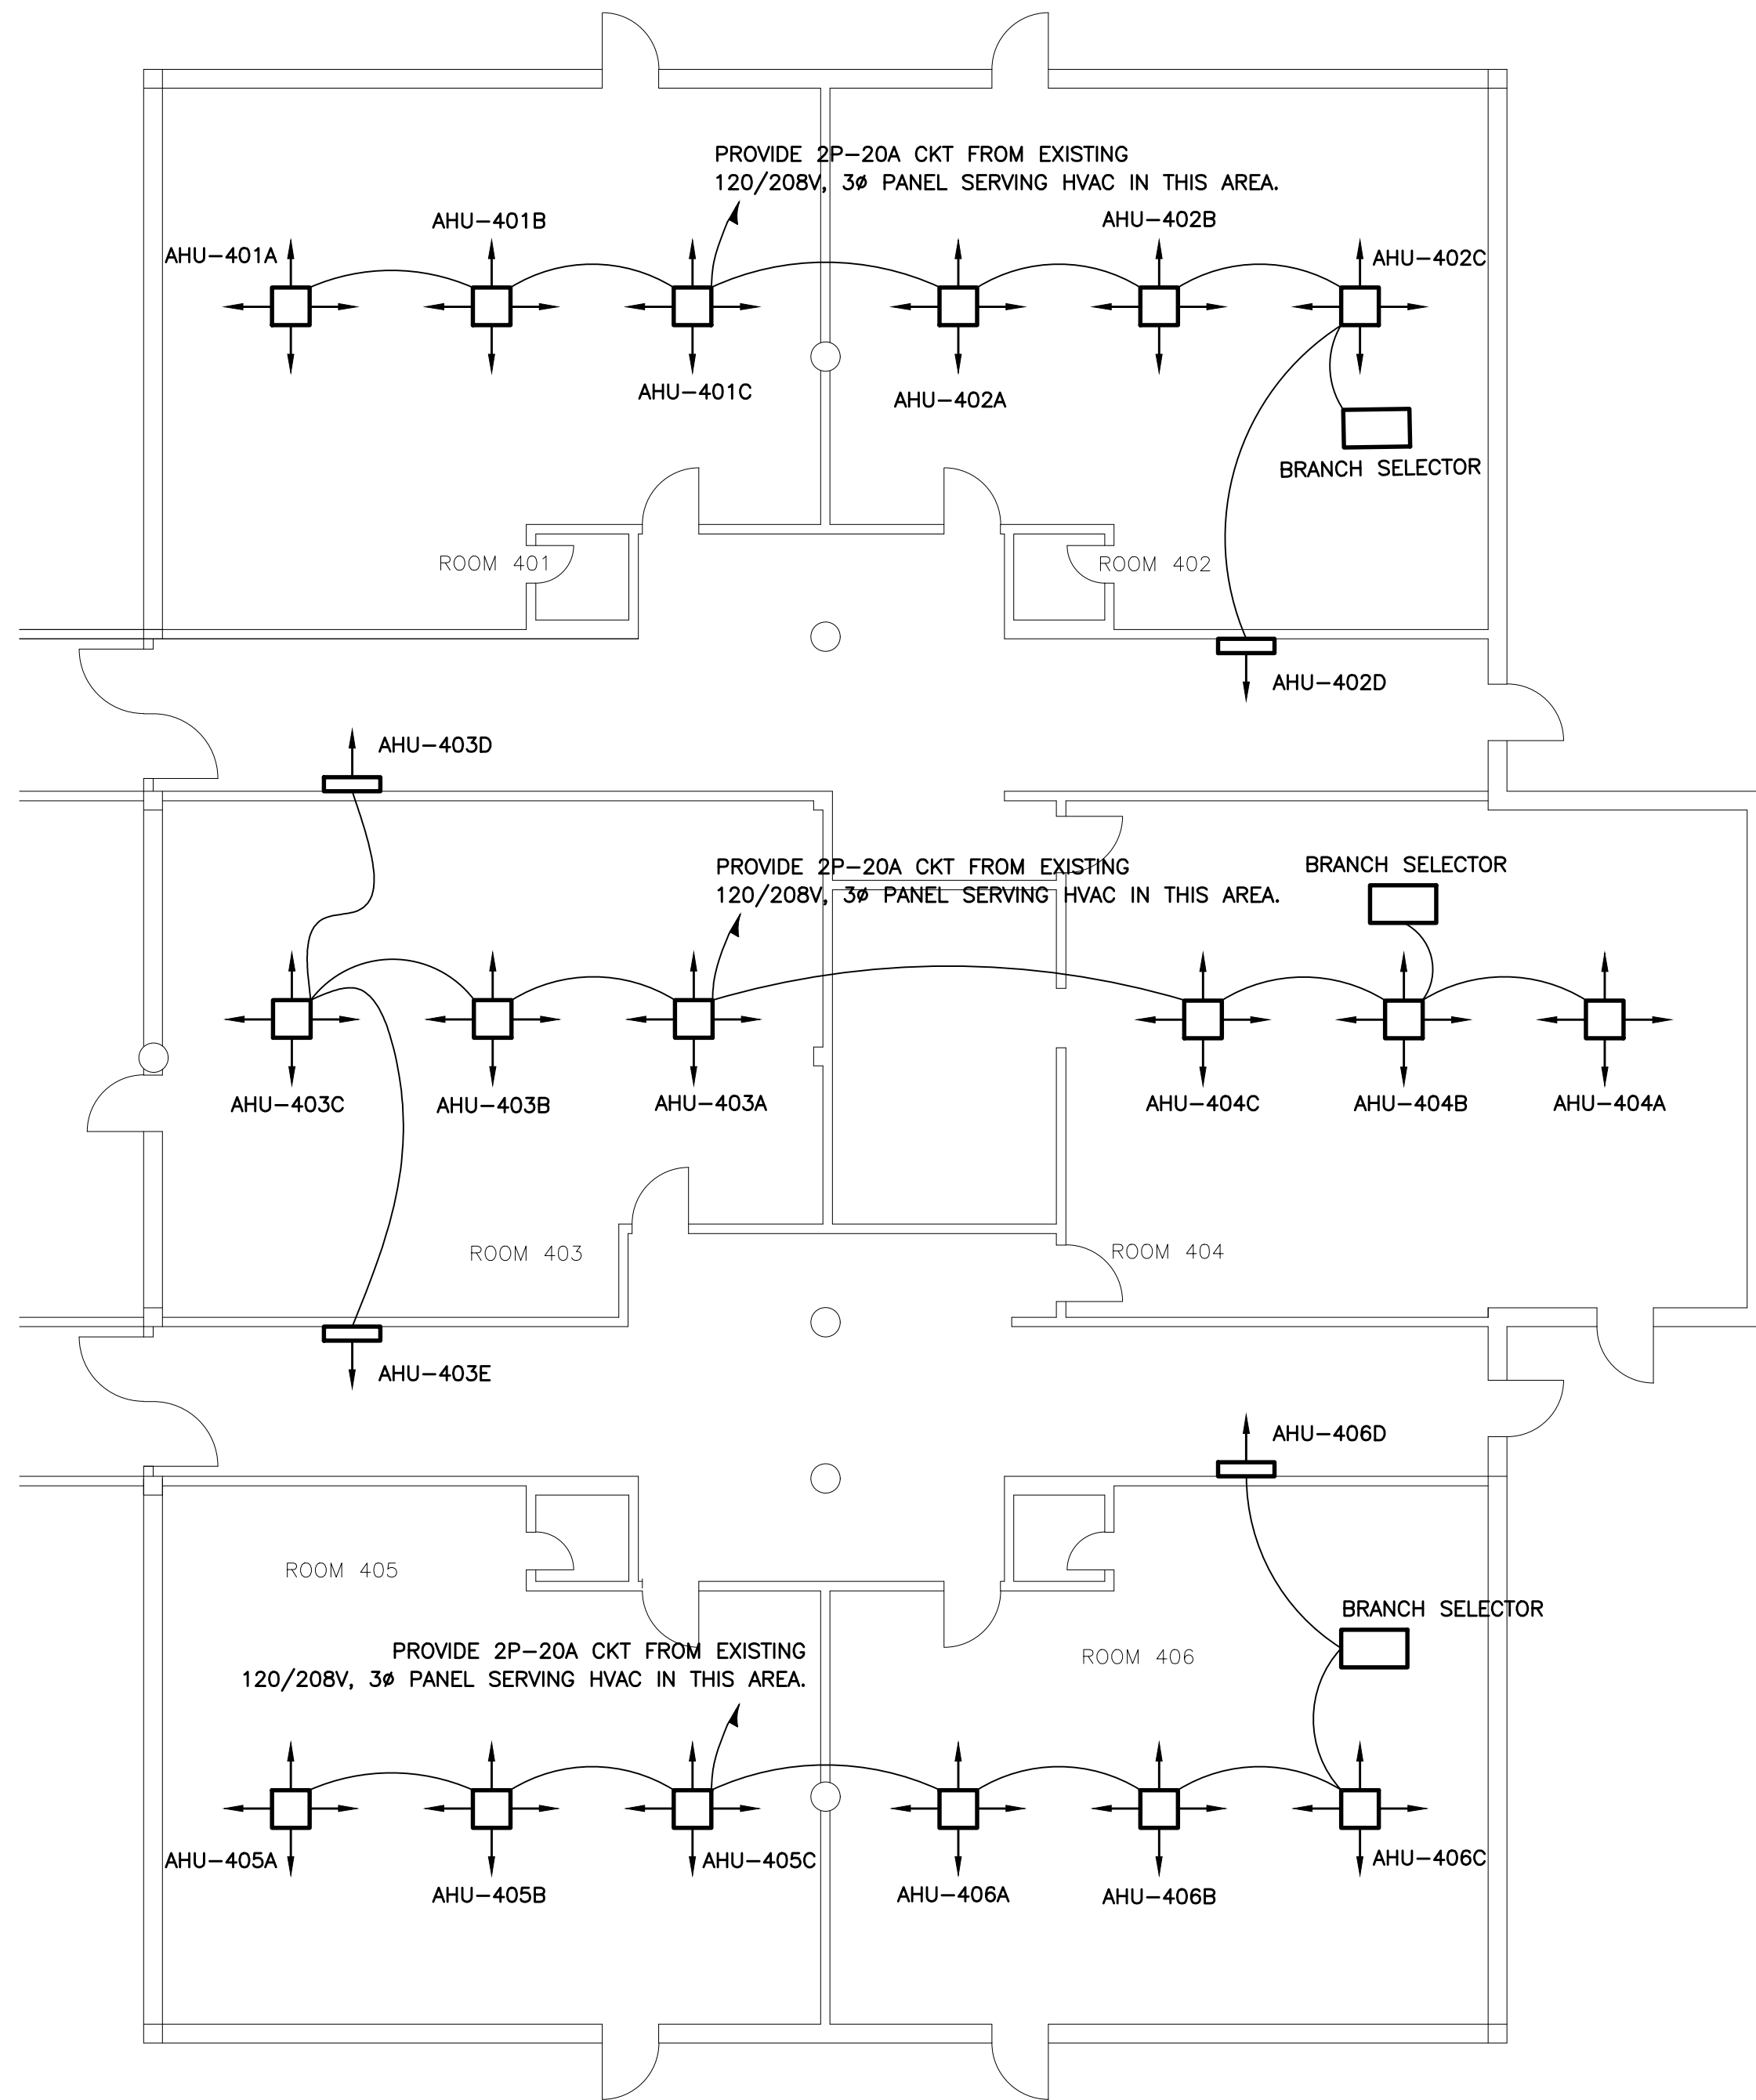


BUILDING 'D' (400 POD) FLOOR PLAN –
HVAC (BASE BID)

1
E101

SCALE: 1/8" = 1'-0"


POWER NOTES:

1. TYPE MC CABLE WITH COPPER CONDUCTORS AND GREEN GROUND MAY BE USED FOR CONCEALED BRANCH CIRCUITS. REDHEAD BUSHINGS SHALL BE PROVIDED AT EACH TERMINATION.
2. ALL CIRCUITS SHALL HAVE EQUIPMENT GROUNDING CONDUCTORS.
3. UNLESS OTHERWISE NOTED FOR 20-AMP CKTS: #10 AWG SHALL BE USED FOR CKTS LONGER THAN 75 FEET. #12 AWG SHALL BE USED FOR CKTS SHORTER THAN 75 FEET.
4. CONDUCTOR SIZES SMALLER THAN #8 AWG SHALL BE SOLID.
5. PROVIDE AND INSTALL CONDUIT FOR HVAC CONTROL WIRING AS REQUIRED. SEE HVAC PLAN FOR T-STATS.
6. FIRESTOP ALL PENETRATIONS THROUGH RATED ASSEMBLIES.

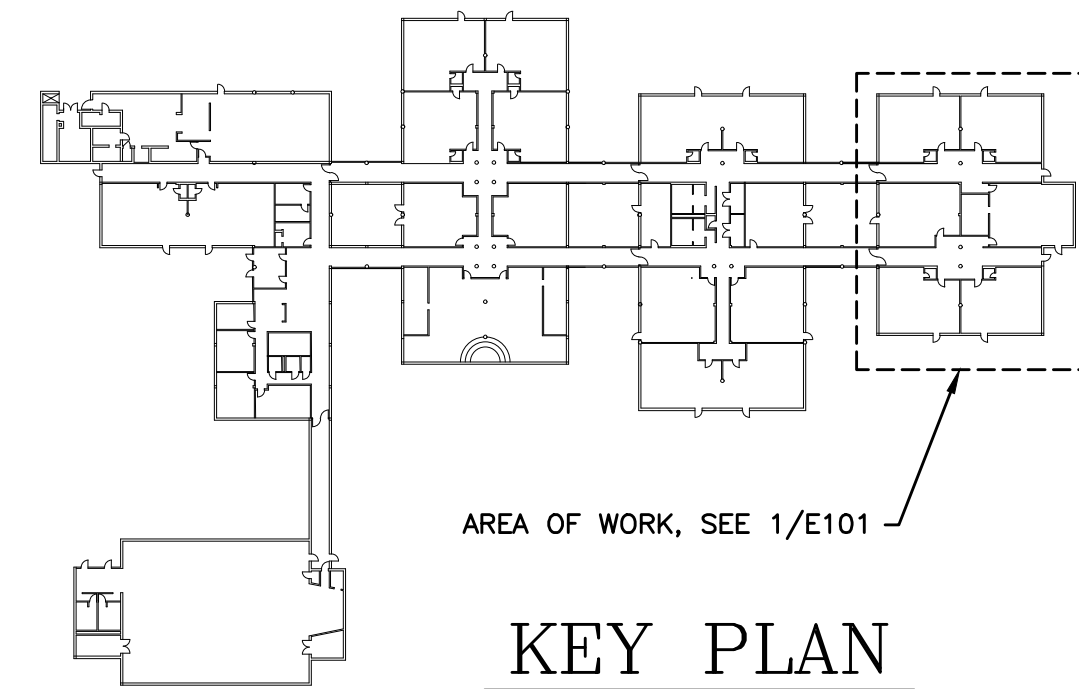

KEY PLAN

NOT TO SCALE


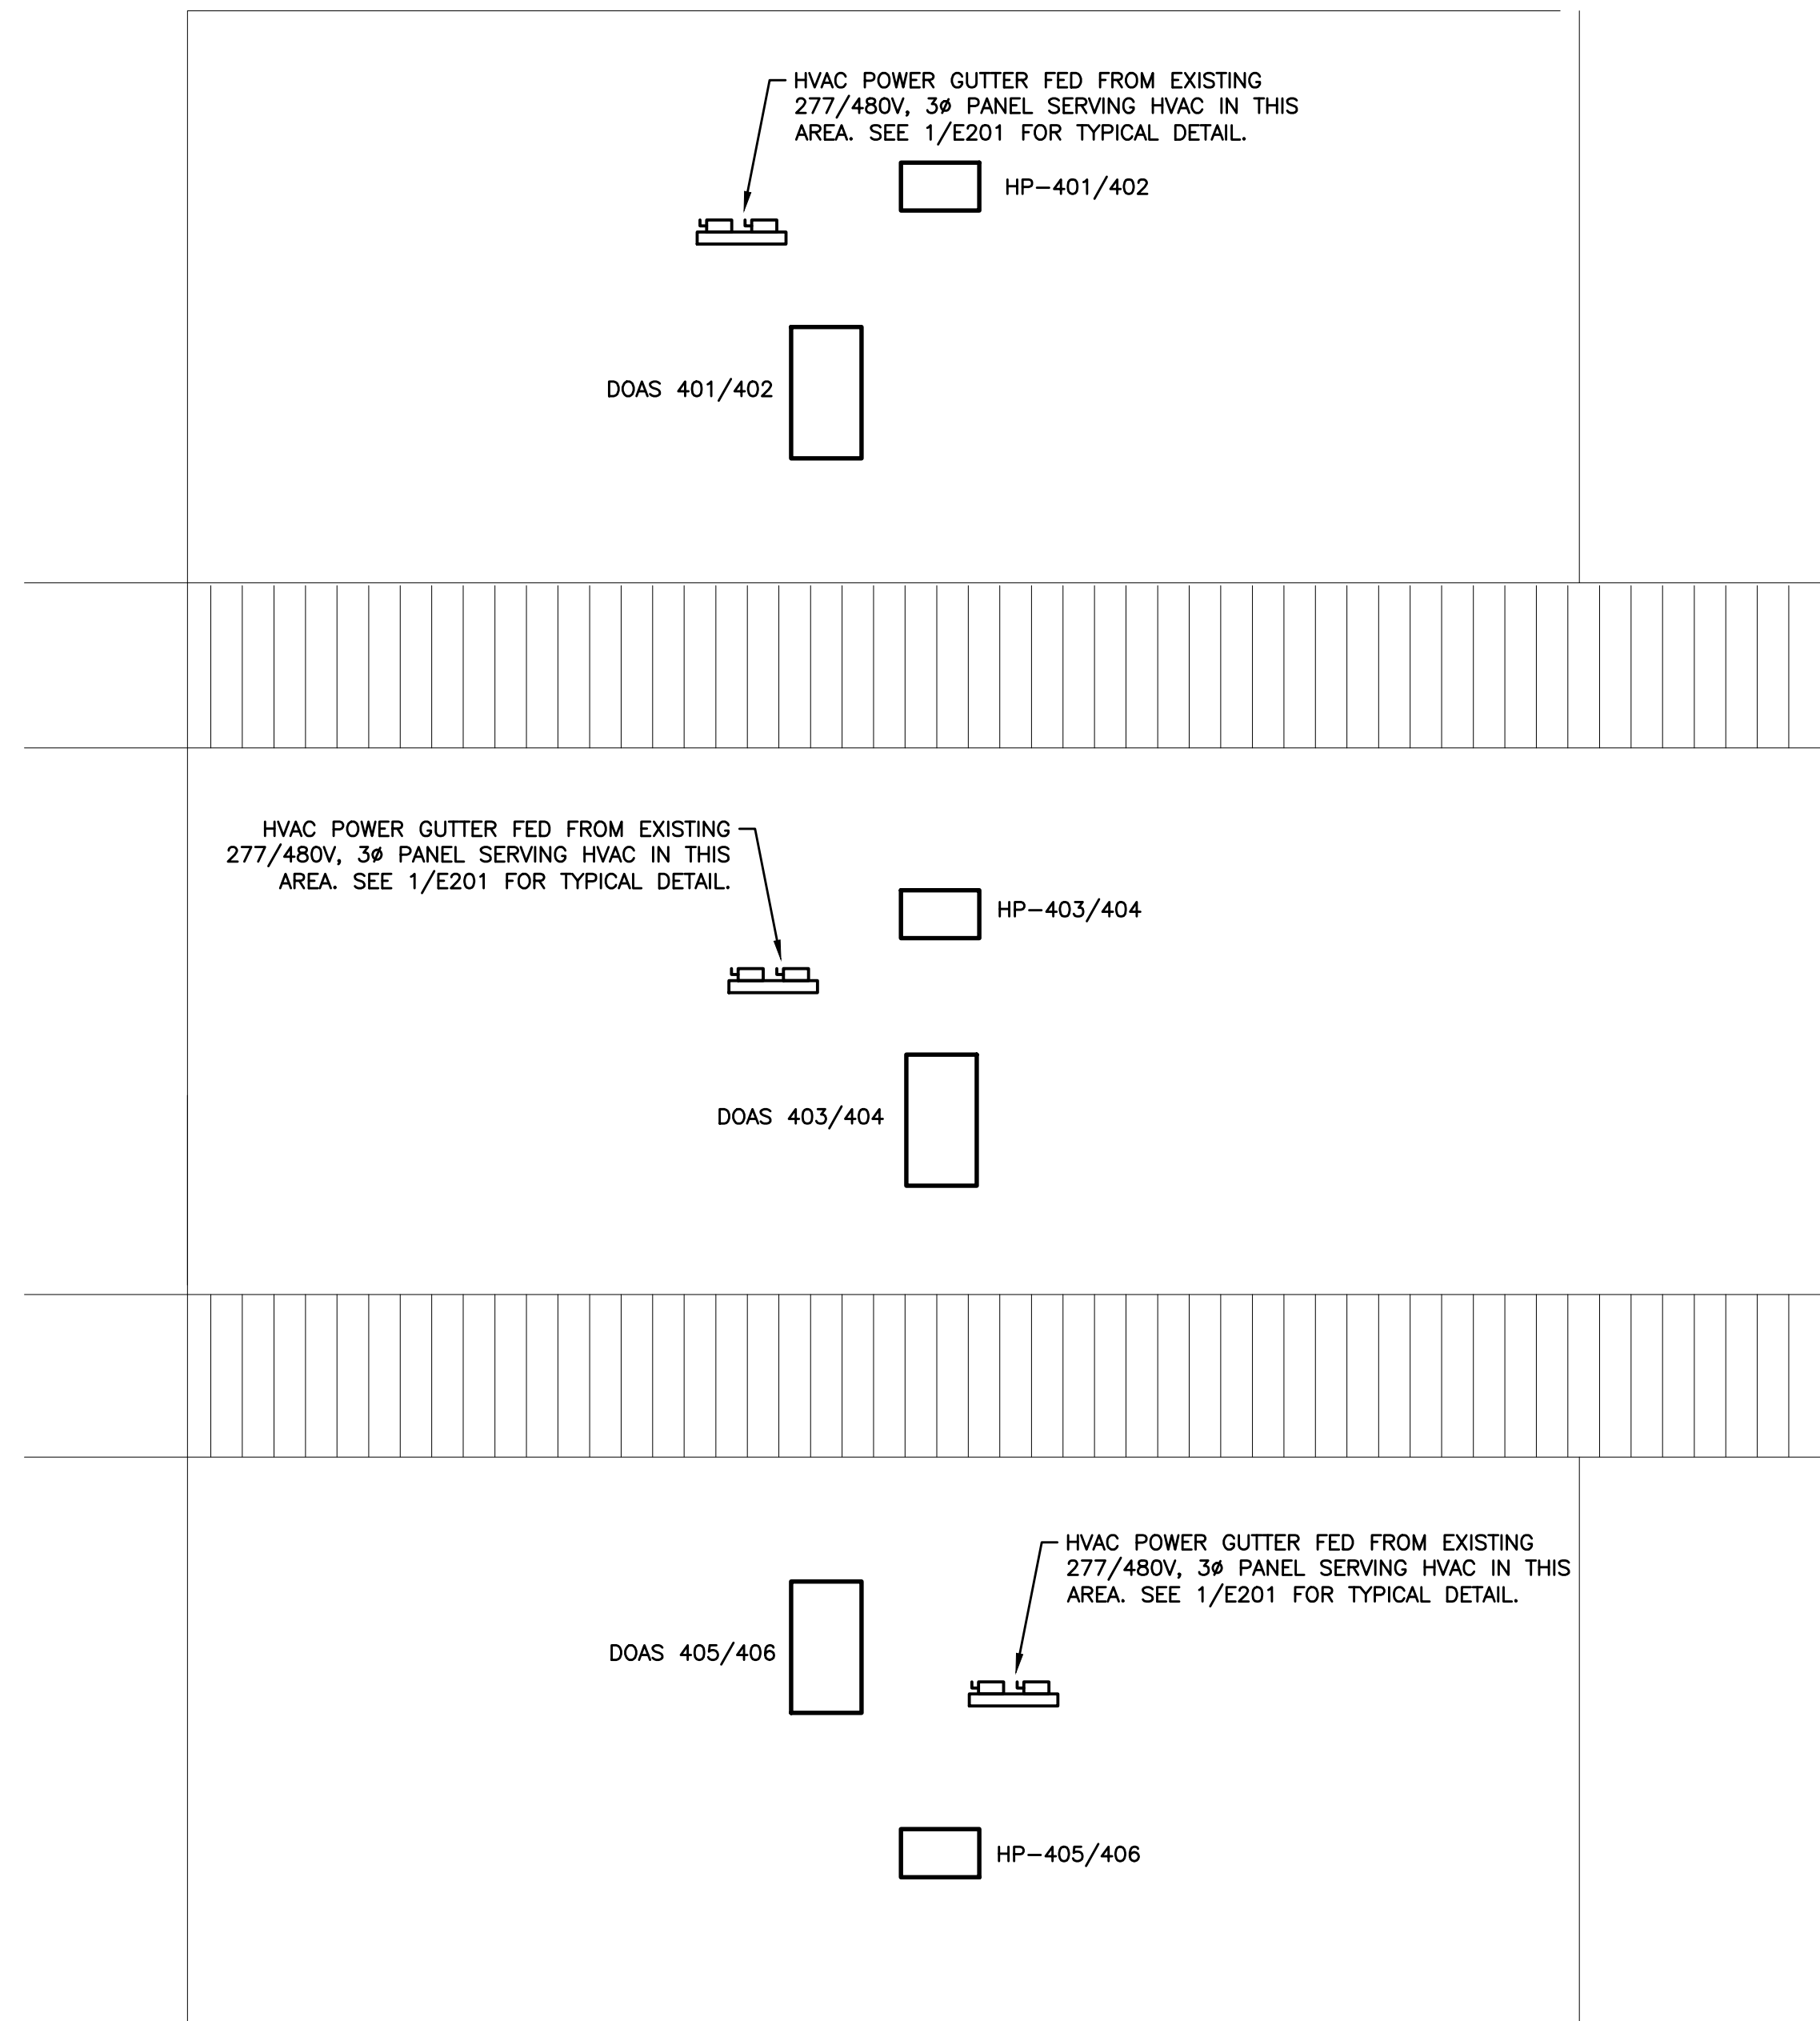


BUILDING 'D' (400 POD) ROOF PLAN –
HVAC (BASE BID)

2
E101

SCALE: 1/8" = 1'-0"

derek@simsengineers.com

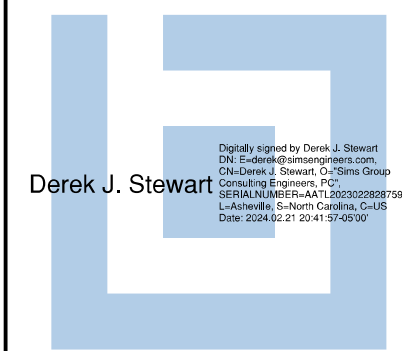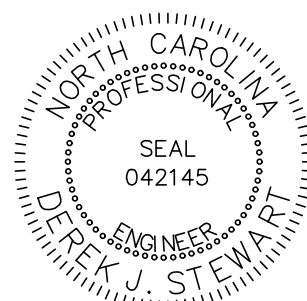

ATKINSON ELEMENTARY SCHOOL

HVAC CHANGEOUT PHASE I
2510 OLD KANUGA RD. HENDERSONVILLE, NC 28739

DATE: 02/21/24

DESIGN BY: DJS


DRAWN BY: RKH/PAM

APPROVED BY: DJS

SHEET NUMBER:

E101

- SCOPE OF WORK NOTES FOR ELECTRICAL ALTERNATE BID #1:
1. BASE BID INCLUDES THE REMOVAL AND REPLACEMENT OF THE CURRENT P-TAC STYLE HVAC UNITS IN ALL CLASSROOM AREAS SHOWN ON THIS PLAN.
 2. EXISTING CLASSROOM HVAC EQUIPMENT IS TO STAY IN SERVICE UNTIL THE NEW UNITS ARE FULLY FUNCTIONAL.
 3. NEW WALL HUNG HVAC UNITS TO BE INSTALLED IN THE CORRIDORS AS SHOWN ABOVE, NO UNITS CURRENTLY IN THIS AREA.
 4. FACTORY COMMISSION AND START-UP OF THE UNITS IS MANDATORY.
 5. FACTORY INSPECTION AND HANDOVER INSPECTION WITH WRITTEN DOCUMENTATION FROM THE FACTORY AND ALL START UP DOCUMENTATION IS REQUIRED FOR FINAL PAYMENT ON THIS PROJECT.
 6. UPON COMPLETION OF THE NEW HVAC SYSTEMS IN EACH CLASSROOM, EXISTING HVAC UNIT BRANCH CIRCUITS ARE TO BE REMOVED TO THE PANEL AND REPLACED PER INSTRUCTIONS ON THIS SHEET.
 7. ADD-ALTERNATE #4 SHALL BE TO REPLACE EXISTING PANELS SERVING HVAC UNITS IN THIS AREA WITH NEW PANELS ON A 1:1 BASIS.
 8. UPON REMOVAL OF THE EXISTING HVAC UNITS, WALL OPENINGS MUST BE SECURED IMMEDIATELY. TEMPORARY COVERS MUST BE WATERTIGHT AND RODENT PROOF UPON LEAVING THE SITE. TEMPORARY COVERS MUST BE SECURED FROM INSIDE THE OF THE BUILDING.
 9. THE BASE BID TO INFILL WALL CAVITIES WHERE EXISTING HVAC UNITS ARE REMOVED SHALL BE: 8-INCH BLOCK LAID IN OPENING, WATERPROOFED, FINISHED AND PAINTED TO MATCH THE EXISTING EXTERIOR FINISH. INTERIOR FINISH OF BLOCK TO BE FLUSH WITH EXISTING WALL AND PAINTED TO MATCH THE EXISTING INTERIOR FINISH.
 10. ADD-ALTERNATE #5: ALTERNATE BID TO INFILL WALL CAVITIES WHERE EXISTING HVAC UNITS ARE REMOVED SHALL BE: FRAMED 2X6 ON 16 "CENTERS MINIMUM, R-38 INSULATION, AT LEAST 7/16" WEATHER PROOF PLYWOOD WITH A MINIMUM OF A ½" BACKER BOARD WITH STUCCO TO MATCH THE EXISTING EXTERIOR FINISH. INTERIOR FINISH MUST BE FLUSH WITH EXISTING BLOCK WALL, CASED WITH 1X4 LUMBER, AND PAINTED TO MATCH THE EXISTING INTERIOR FINISH.

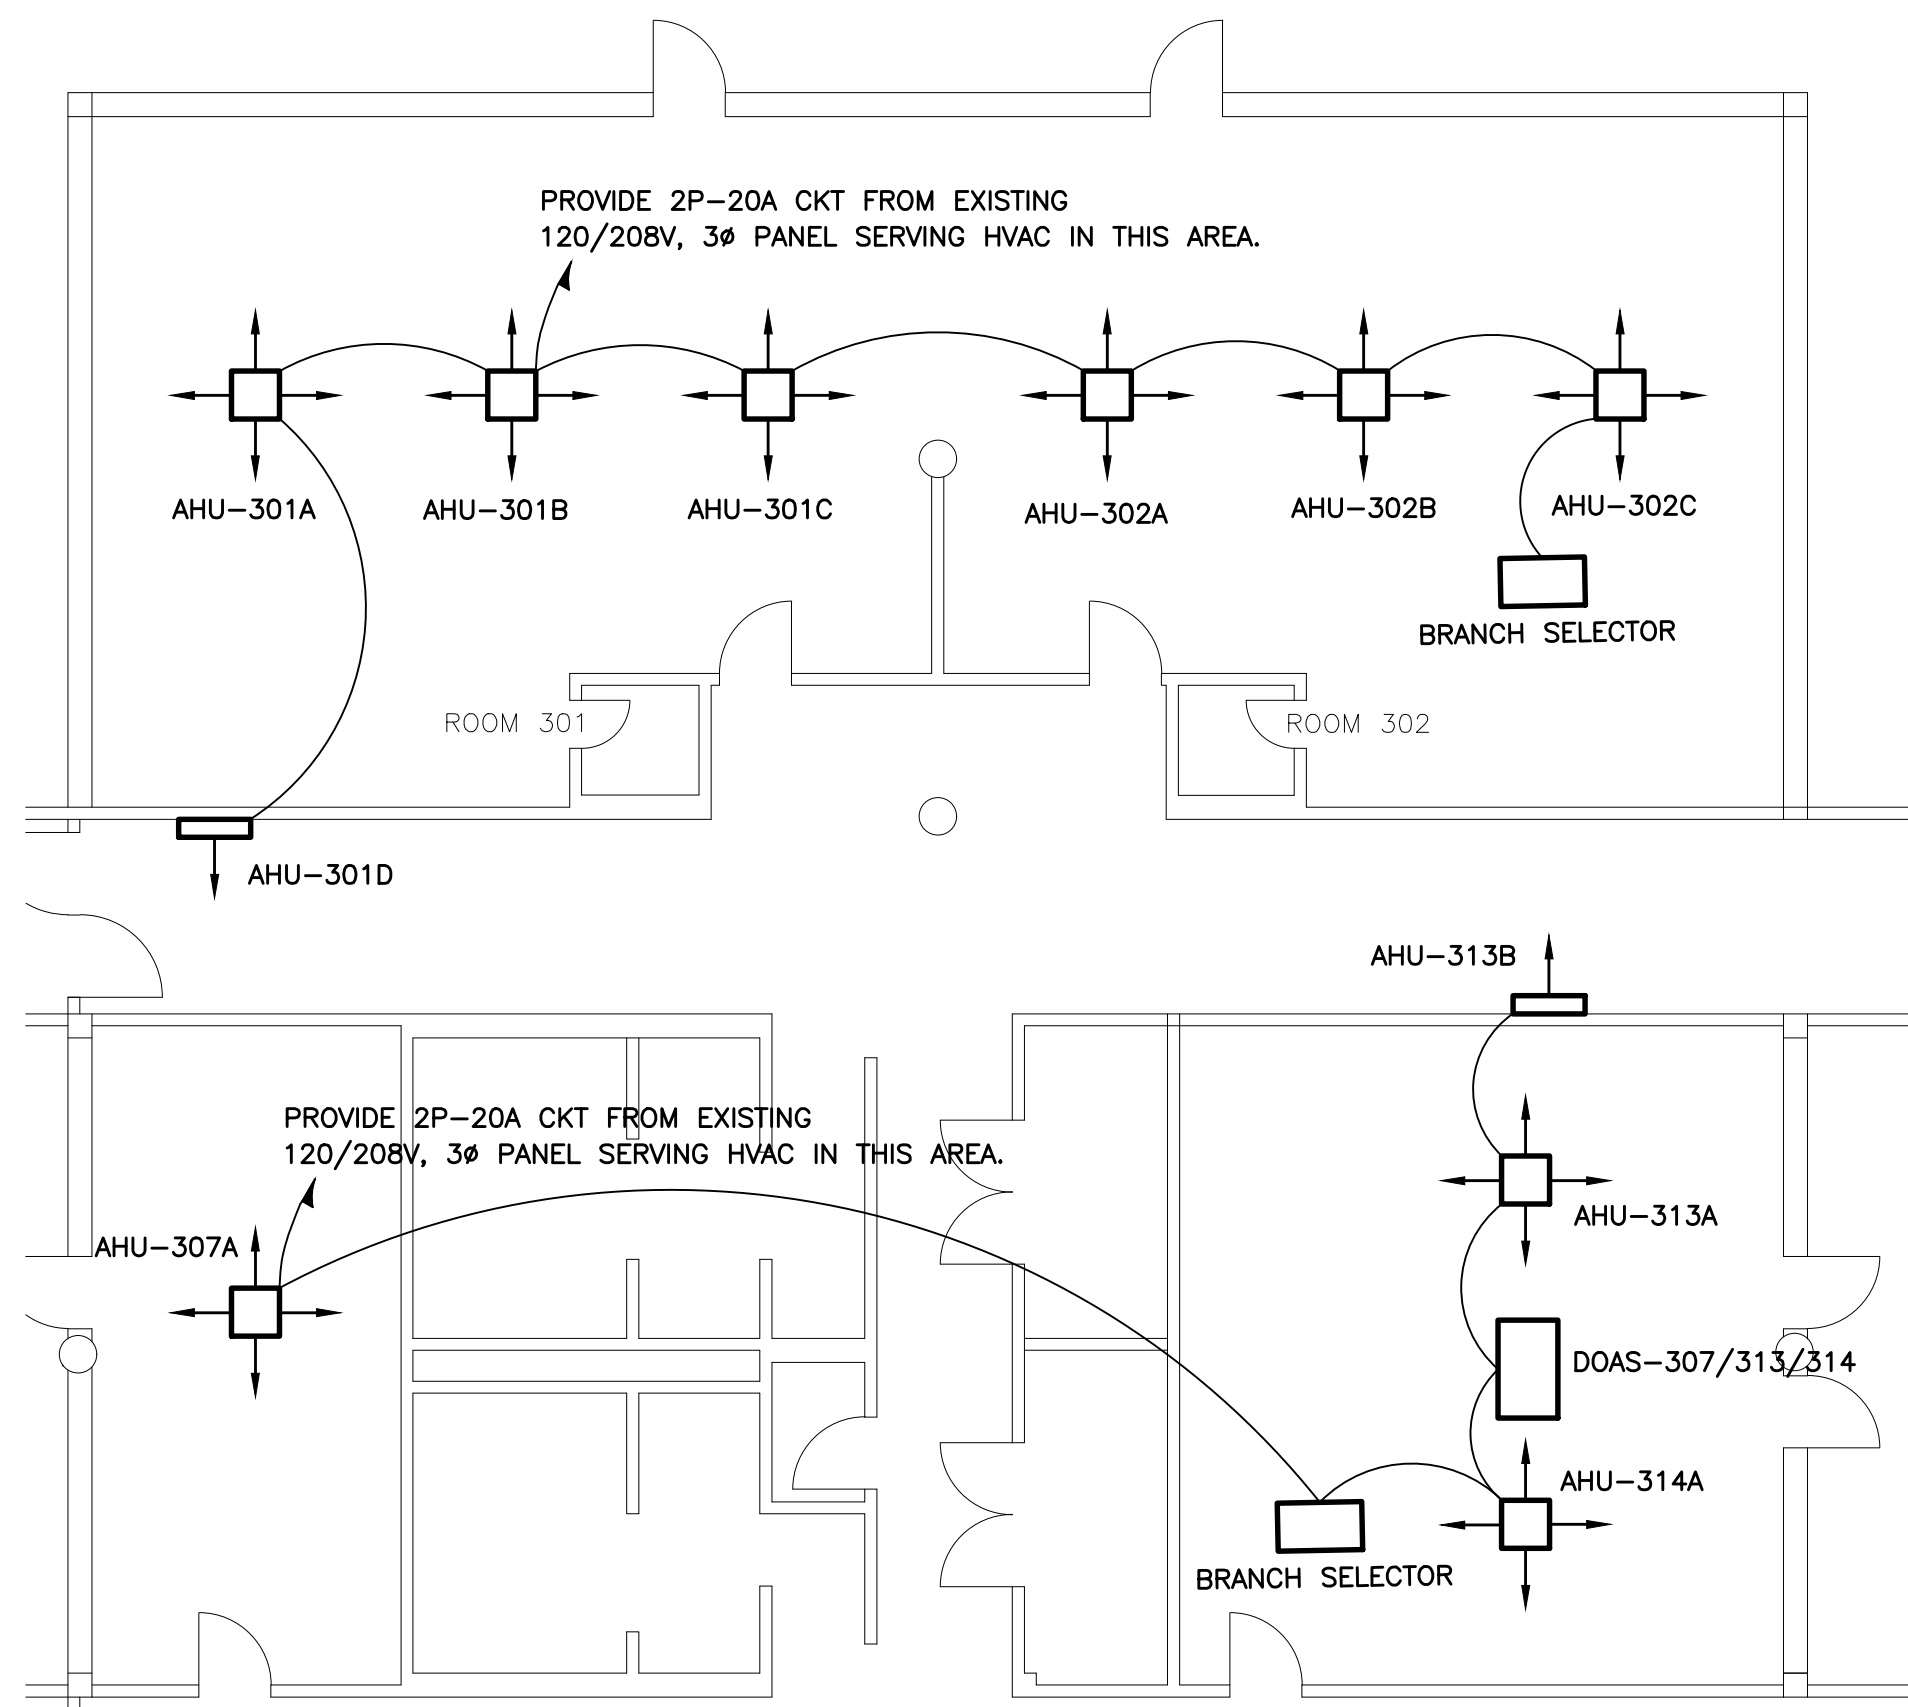


BUILDING 'C' (300 POD) FLOOR PLAN –
ELECTRICAL (ALTERNATE BID #1)

SCALE: 1/8" = 1'-0"


POWER NOTES:

1. TYPE MC CABLE WITH COPPER CONDUCTORS AND GREEN GROUND MAY BE USED FOR CONCEALED BRANCH CIRCUITS. REDHEAD BUSHINGS SHALL BE PROVIDED AT EACH TERMINATION.
2. ALL CIRCUITS SHALL HAVE EQUIPMENT GROUNDING CONDUCTORS.
3. UNLESS OTHERWISE NOTED FOR 20-AMP CKTS: #10 AWG SHALL BE USED FOR CKTS LONGER THAN 75 FEET. #12 AWG SHALL BE USED FOR CKTS SHORTER THAN 75 FEET.
4. CONDUCTOR SIZES SMALLER THAN #8 AWG SHALL BE SOLID.
5. PROVIDE AND INSTALL CONDUIT FOR HVAC CONTROL WIRING AS REQUIRED. SEE HVAC PLAN FOR T-STATS.
6. FIRESTOP ALL PENETRATIONS THROUGH RATED ASSEMBLIES.

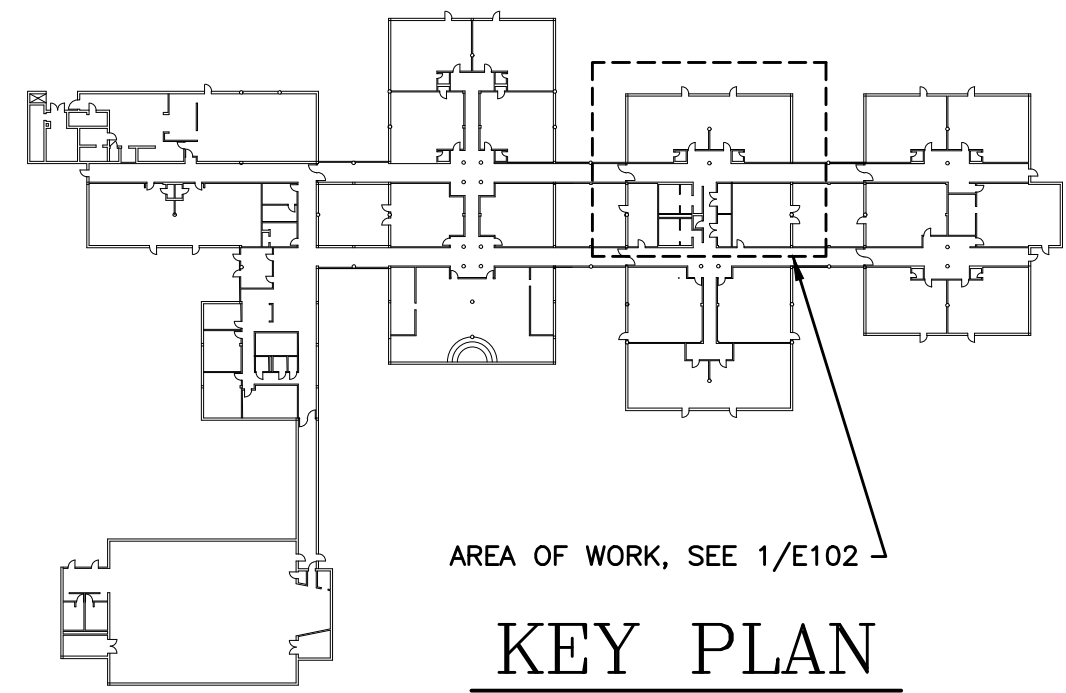

KEY PLAN

NOT TO SCALE

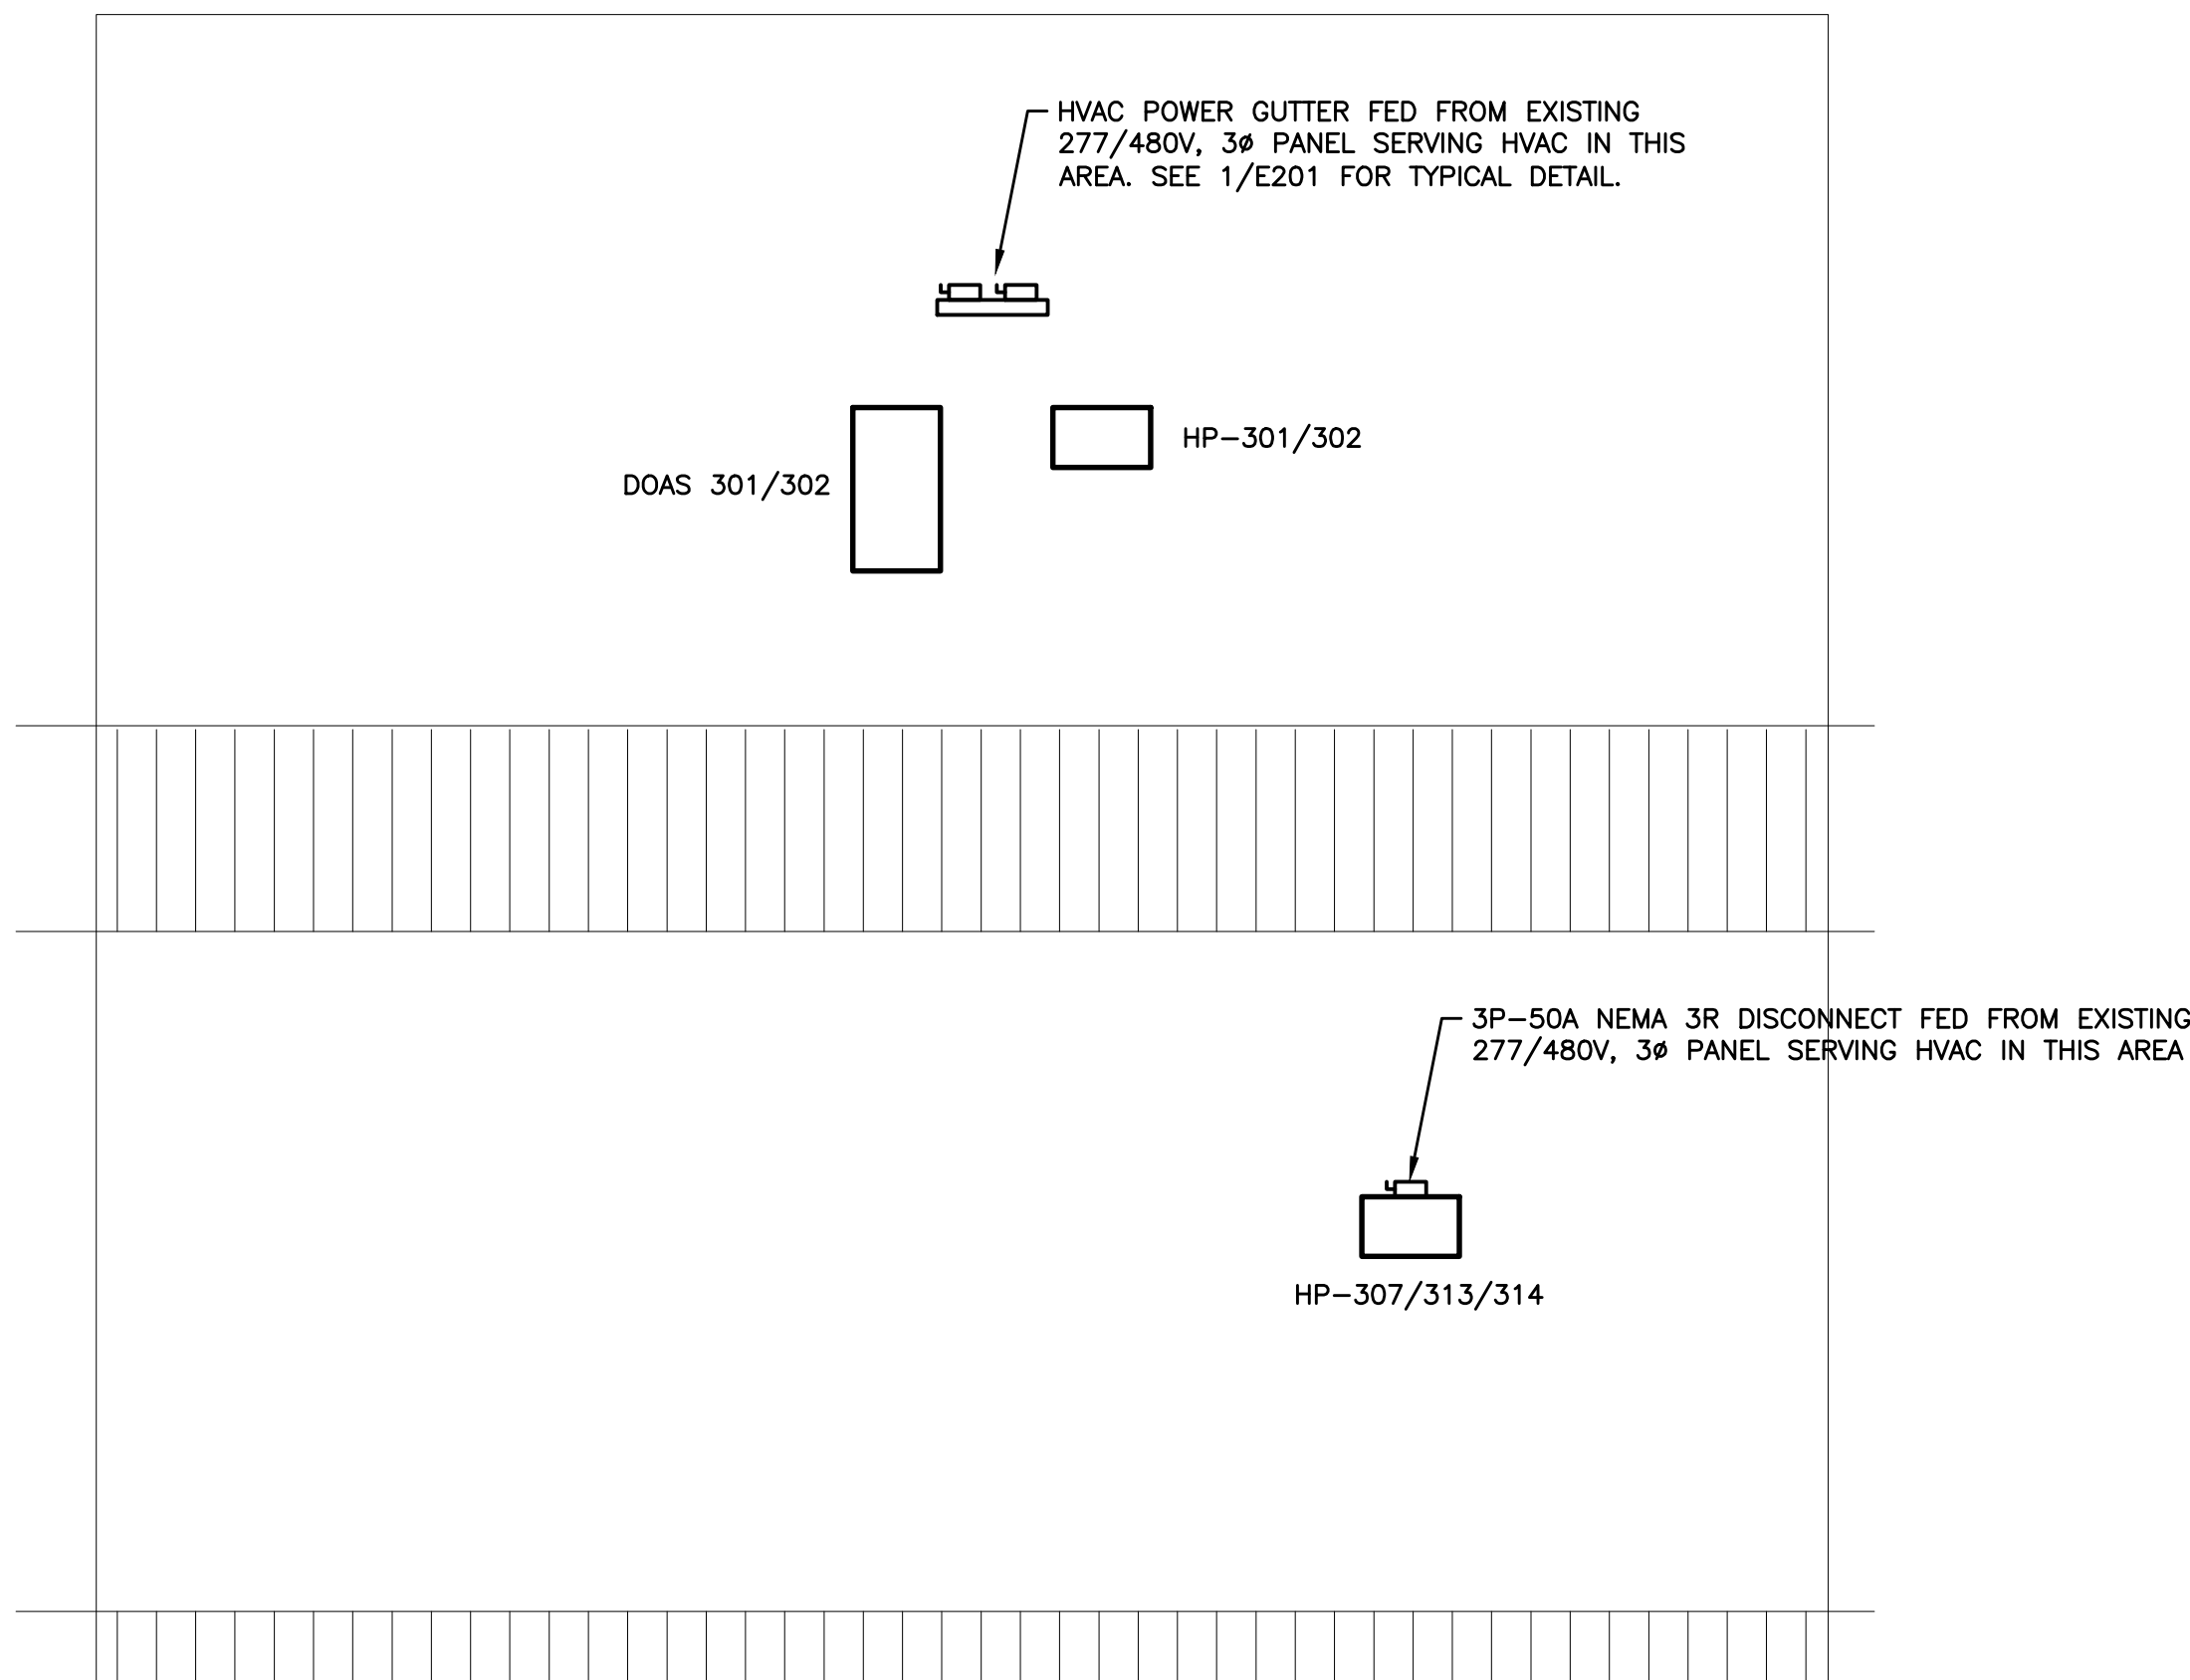


BUILDING 'C' (300 POD) ROOF PLAN –
ELECTRICAL (ALTERNATE BID #1)

SCALE: 1/8" = 1'-0"

sims group
CONSULTING ENGINEERS, PC
PO BOX 5534 • ASHEVILLE, NC 28813
PHONE: 828-251-2025 • FAX: 828-251-1933
www.simgroupconsultingengineers.com
N.C. LICENSE # ELEC 2864
THIS DRAWING IS THE PROPERTY OF SIMS GROUP CONSULTING ENGINEERS, PC. IT MAY NOT BE REPRODUCED OR USED IN ANY MANNER WITHOUT PERMISSION.

derek@simsengineers.com



ATKINSON ELEMENTARY SCHOOL

HVAC CHANGEOUT PHASE I
2510 OLD KANUGA RD. HENDERSONVILLE, NC 28739

DATE: 02/21/24

DESIGN BY: DJS

DRAWN BY: RKH/PAM


APPROVED BY: DJS

SHEET NUMBER:

E102

SCOPE OF WORK NOTES FOR ELECTRICAL ALTERNATE BID #2:

1. BASE BID INCLUDES THE REMOVAL AND REPLACEMENT OF THE CURRENT P-TAC STYLE HVAC UNITS IN ALL CLASSROOM AREAS SHOWN ON THIS PLAN.
2. EXISTING CLASSROOM HVAC EQUIPMENT IS TO STAY IN SERVICE UNTIL THE NEW UNITS ARE FULLY FUNCTIONAL.
3. NEW WALL HUNG HVAC UNITS TO BE INSTALLED IN THE CORRIDORS AS SHOWN ABOVE, NO UNITS CURRENTLY IN THIS AREA.
4. FACTORY COMMISSION AND START-UP OF THE UNITS IS MANDATORY.
5. FACTORY INSPECTION AND HANDOVER INSPECTION WITH WRITTEN DOCUMENTATION FROM THE FACTORY AND ALL START UP DOCUMENTATION IS REQUIRED FOR FINAL PAYMENT ON THIS PROJECT.
6. UPON COMPLETION OF THE NEW HVAC SYSTEMS IN EACH CLASSROOM, EXISTING HVAC UNIT BRANCH CIRCUITS ARE TO BE REMOVED TO THE PANEL AND REPLACED PER INSTRUCTIONS ON THIS SHEET.
7. ADD-ALTERNATE #4 SHALL BE TO REPLACE EXISTING PANELS SERVING HVAC UNITS IN THIS AREA WITH NEW PANELS ON A 1:1 BASIS.
8. UPON REMOVAL OF THE EXISTING HVAC UNITS, WALL OPENINGS MUST BE SECURED IMMEDIATELY. TEMPORARY COVERS MUST BE WATERTIGHT AND RODENT PROOF UPON LEAVING THE SITE. TEMPORARY COVERS MUST BE SECURED FROM INSIDE THE OF THE BUILDING.
9. THE BASE BID TO INFILL WALL CAVITIES WHERE EXISTING HVAC UNITS ARE REMOVED SHALL BE: 8-INCH BLOCK LAID IN OPENING, WATERPROOFED, FINISHED AND PAINTED TO MATCH THE EXISTING EXTERIOR FINISH. INTERIOR FINISH OF BLOCK TO BE FLUSH WITH EXISTING WALL AND PAINTED TO MATCH THE EXISTING INTERIOR FINISH.
10. ADD-ALTERNATE #5: ALTERNATE BID TO INFILL WALL CAVITIES WHERE EXISTING HVAC UNITS ARE REMOVED SHALL BE: FRAMED 2X6 ON 16 "CENTERS MINIMUM, R-38 INSULATION, AT LEAST 7/16" WEATHER PROOF PLYWOOD WITH A MINIMUM OF A ½" BACKER BOARD WITH STUCCO TO MATCH THE EXISTING EXTERIOR FINISH. INTERIOR FINISH MUST BE FLUSH WITH EXISTING BLOCK WALL, CASED WITH 1X4 LUMBER, AND PAINTED TO MATCH THE EXISTING INTERIOR FINISH.

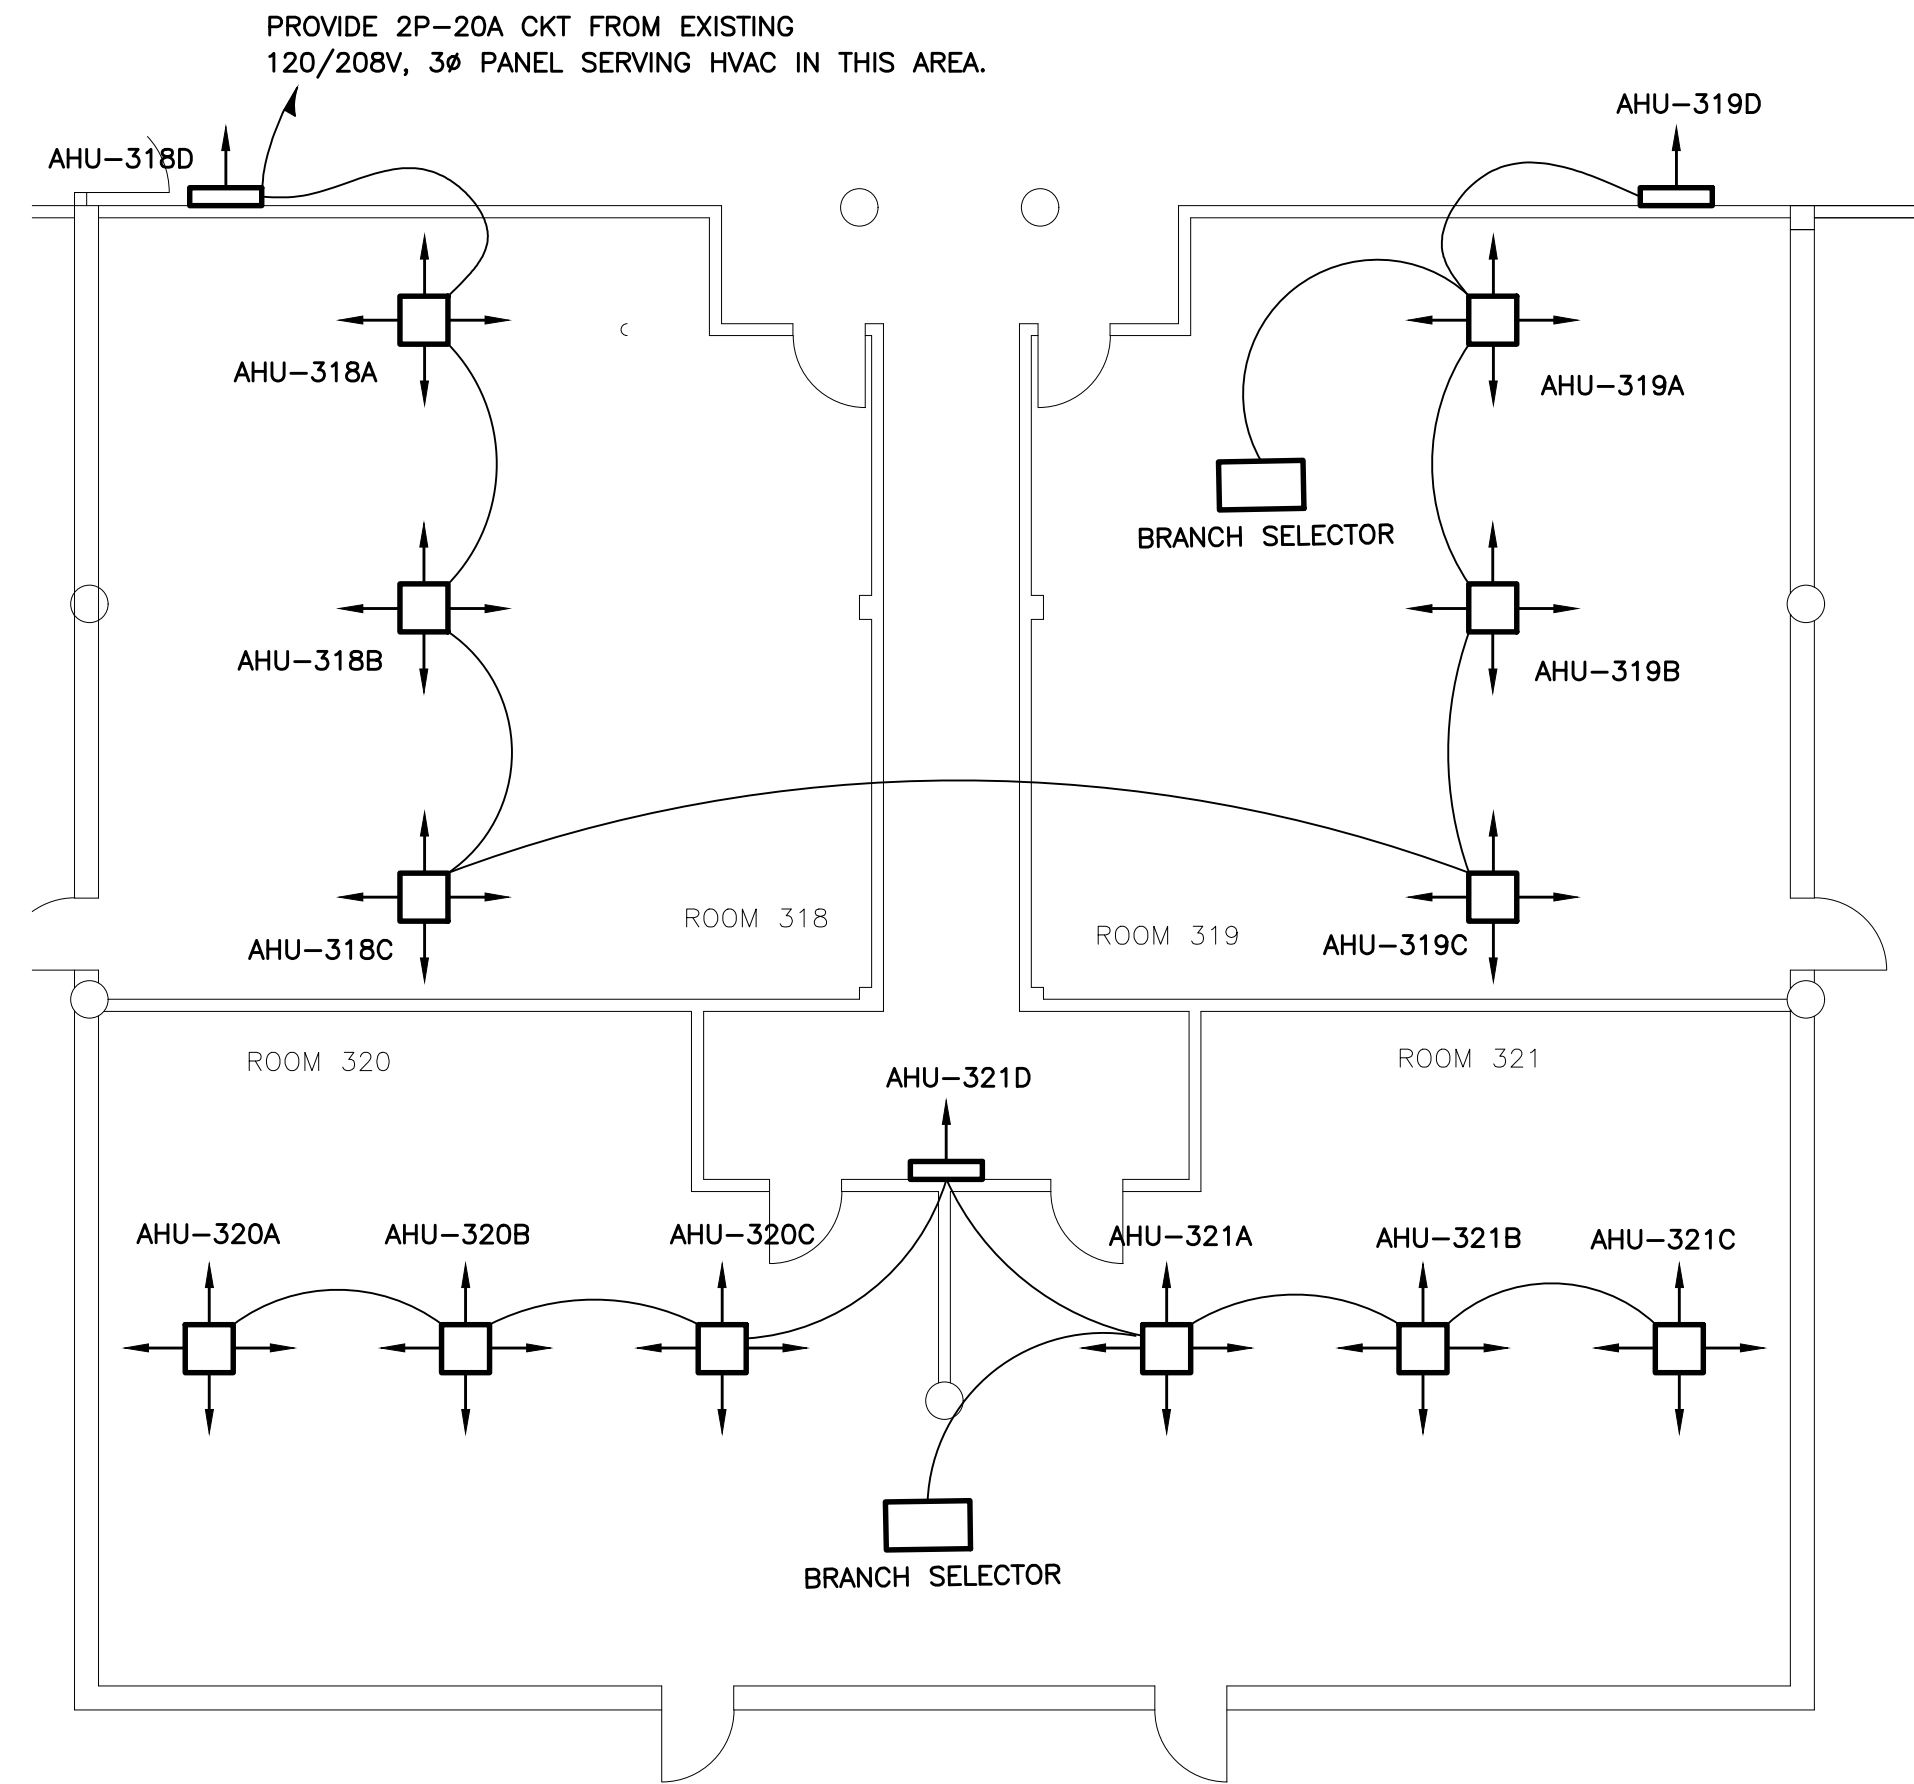



BUILDING 'C' (300 POD) FLOOR PLAN –
ELECTRICAL (ALTERNATE BID #2)

1
E103

SCALE: 1/8" = 1'-0"

POWER NOTES:

1. TYPE MC CABLE WITH COPPER CONDUCTORS AND GREEN GROUND MAY BE USED FOR CONCEALED BRANCH CIRCUITS. REDHEAD BUSHINGS SHALL BE PROVIDED AT EACH TERMINATION.
2. ALL CIRCUITS SHALL HAVE EQUIPMENT GROUNDING CONDUCTORS.
3. UNLESS OTHERWISE NOTED FOR 20-AMP CKTS: #10 AWG SHALL BE USED FOR CKTS LONGER THAN 75 FEET. #12 AWG SHALL BE USED FOR CKTS SHORTER THAN 75 FEET.
4. CONDUCTOR SIZES SMALLER THAN #8 AWG SHALL BE SOLID.
5. PROVIDE AND INSTALL CONDUIT FOR HVAC CONTROL WIRING AS REQUIRED. SEE HVAC PLAN FOR T-STATS.
6. FIRESTOP ALL PENETRATIONS THROUGH RATED ASSEMBLIES.

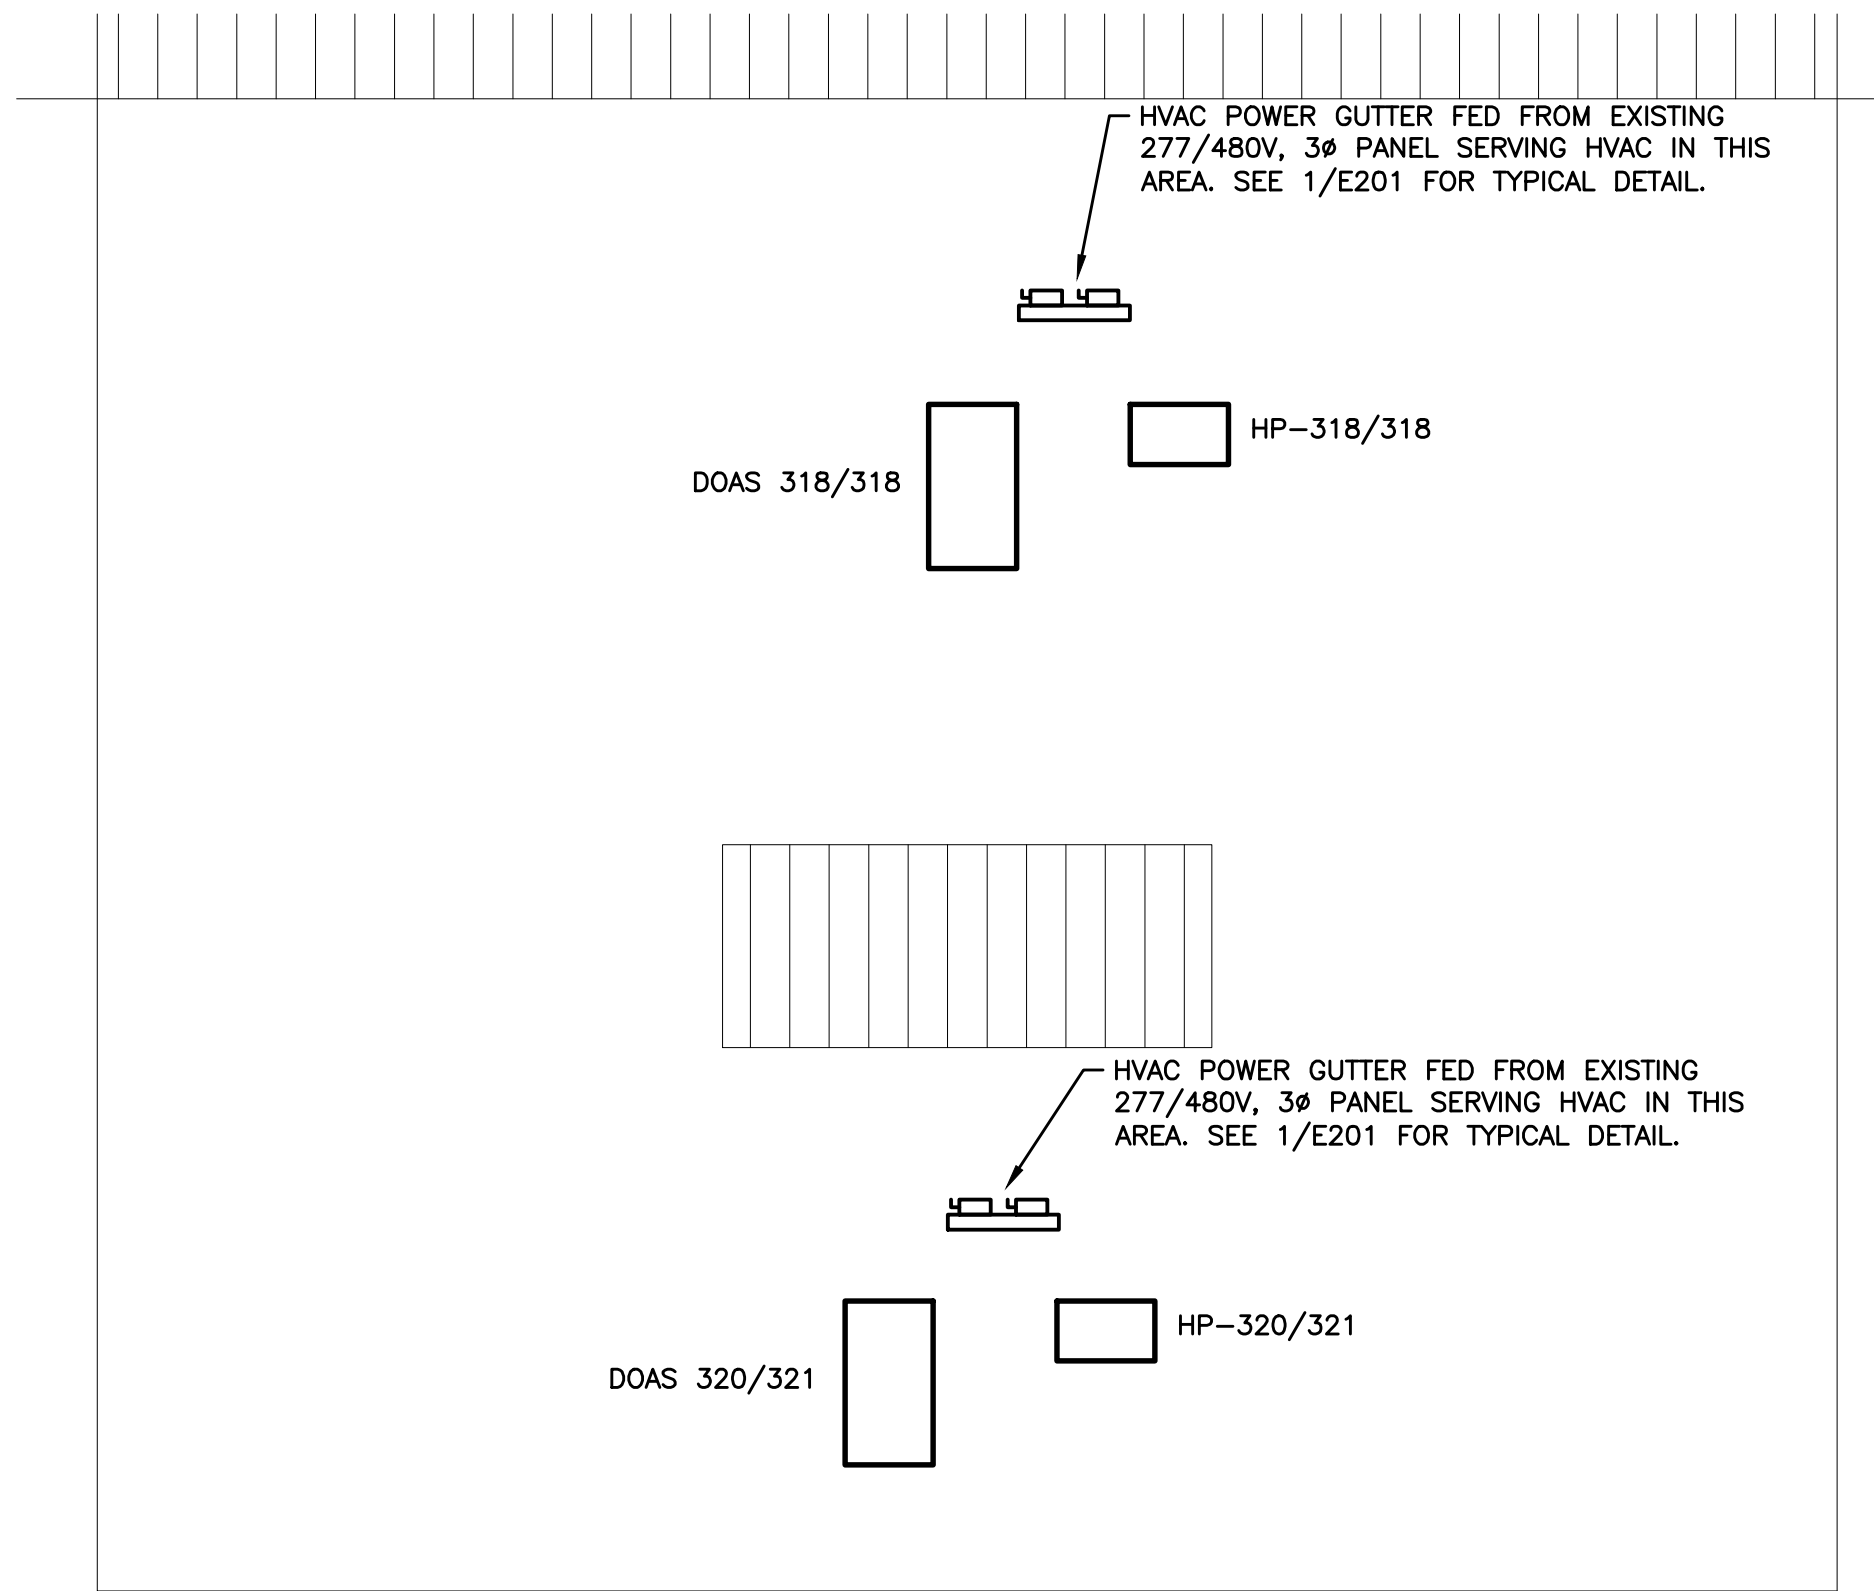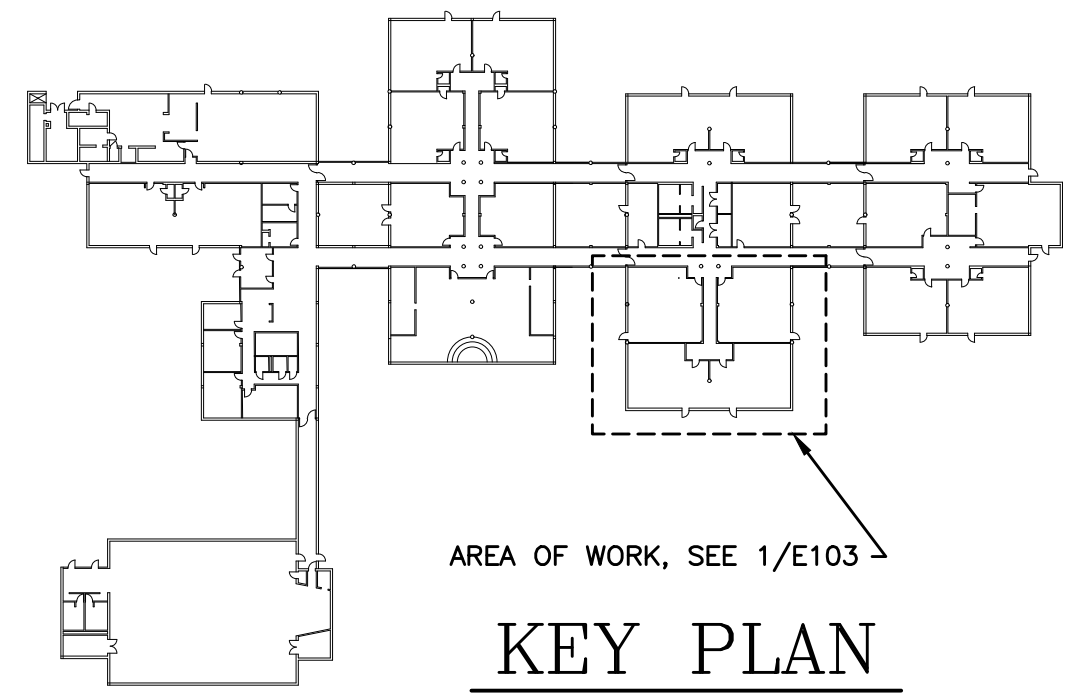

BUILDING 'C' (300 POD) ROOF PLAN –
ELECTRICAL (ALTERNATE BID #2)

2
E103

SCALE: 1/8" = 1'-0"

sims group
CONSULTING ENGINEERS, PC
PO BOX 5534 • ASHEVILLE, NC 28813
PHONE: 828-251-2025 • FAX: 828-251-1933
www.simgroup-engineers.com
NORTH CAROLINA LICENSE #2284



ATKINSON ELEMENTARY SCHOOL

HVAC CHANGEOUT PHASE I
2510 OLD KANUGA RD. HENDERSONVILLE, NC 28739

DATE: 02/21/24

DESIGN BY: DJS

DRAWN BY: RKH/PAM



APPROVED BY: DJS

SHEET NUMBER:

E103

SCOPE OF WORK NOTES FOR ELECTRICAL ALTERNATE BID #3:

1. BASE BID INCLUDES THE REMOVAL AND REPLACEMENT OF THE CURRENT P-TAC STYLE HVAC UNITS IN ALL CLASSROOM AREAS SHOWN ON THIS PLAN.
2. EXISTING CLASSROOM HVAC EQUIPMENT IS TO STAY IN SERVICE UNTIL THE NEW UNITS ARE FULLY FUNCTIONAL.
3. NEW WALL HUNG HVAC UNITS TO BE INSTALLED IN THE CORRIDORS AS SHOWN ABOVE, NO UNITS CURRENTLY IN THIS AREA.
4. FACTORY COMMISSION AND START-UP OF THE UNITS IS MANDATORY.
5. FACTORY INSPECTION AND HANDOVER INSPECTION WITH WRITTEN DOCUMENTATION FROM THE FACTORY AND ALL START UP DOCUMENTATION IS REQUIRED FOR FINAL PAYMENT ON THIS PROJECT.
6. UPON COMPLETION OF THE NEW HVAC SYSTEMS IN EACH CLASSROOM, EXISTING HVAC UNIT BRANCH CIRCUITS ARE TO BE REMOVED TO THE PANEL AND REPLACED PER INSTRUCTIONS ON THIS SHEET.
7. ADD-ALTERNATE #4 SHALL BE TO REPLACE EXISTING PANELS SERVING HVAC UNITS IN THIS AREA WITH NEW PANELS ON A 1:1 BASIS.
8. UPON REMOVAL OF THE EXISTING HVAC UNITS, WALL OPENINGS MUST BE SECURED IMMEDIATELY. TEMPORARY COVERS MUST BE WATERTIGHT AND RODENT PROOF UPON LEAVING THE SITE. TEMPORARY COVERS MUST BE SECURED FROM INSIDE THE OF THE BUILDING.
9. THE BASE BID TO INFILL WALL CAVITIES WHERE EXISTING HVAC UNITS ARE REMOVED SHALL BE: 8-INCH BLOCK LAID IN OPENING, WATERPROOFED, FINISHED AND PAINTED TO MATCH THE EXISTING EXTERIOR FINISH. INTERIOR FINISH OF BLOCK TO BE FLUSH WITH EXISTING WALL AND PAINTED TO MATCH THE EXISTING INTERIOR FINISH.
10. ADD-ALTERNATE #5: ALTERNATE BID TO INFILL WALL CAVITIES WHERE EXISTING HVAC UNITS ARE REMOVED SHALL BE: FRAMED 2X6 ON 16 "CENTERS MINIMUM, R-38 INSULATION, AT LEAST 7/16" WEATHER PROOF PLYWOOD WITH A MINIMUM OF A 1/2" BACKER BOARD WITH STUCCO TO MATCH THE EXISTING EXTERIOR FINISH. INTERIOR FINISH MUST BE FLUSH WITH EXISTING BLOCK WALL, CASED WITH 1X4 LUMBER, AND PAINTED TO MATCH THE EXISTING INTERIOR FINISH.

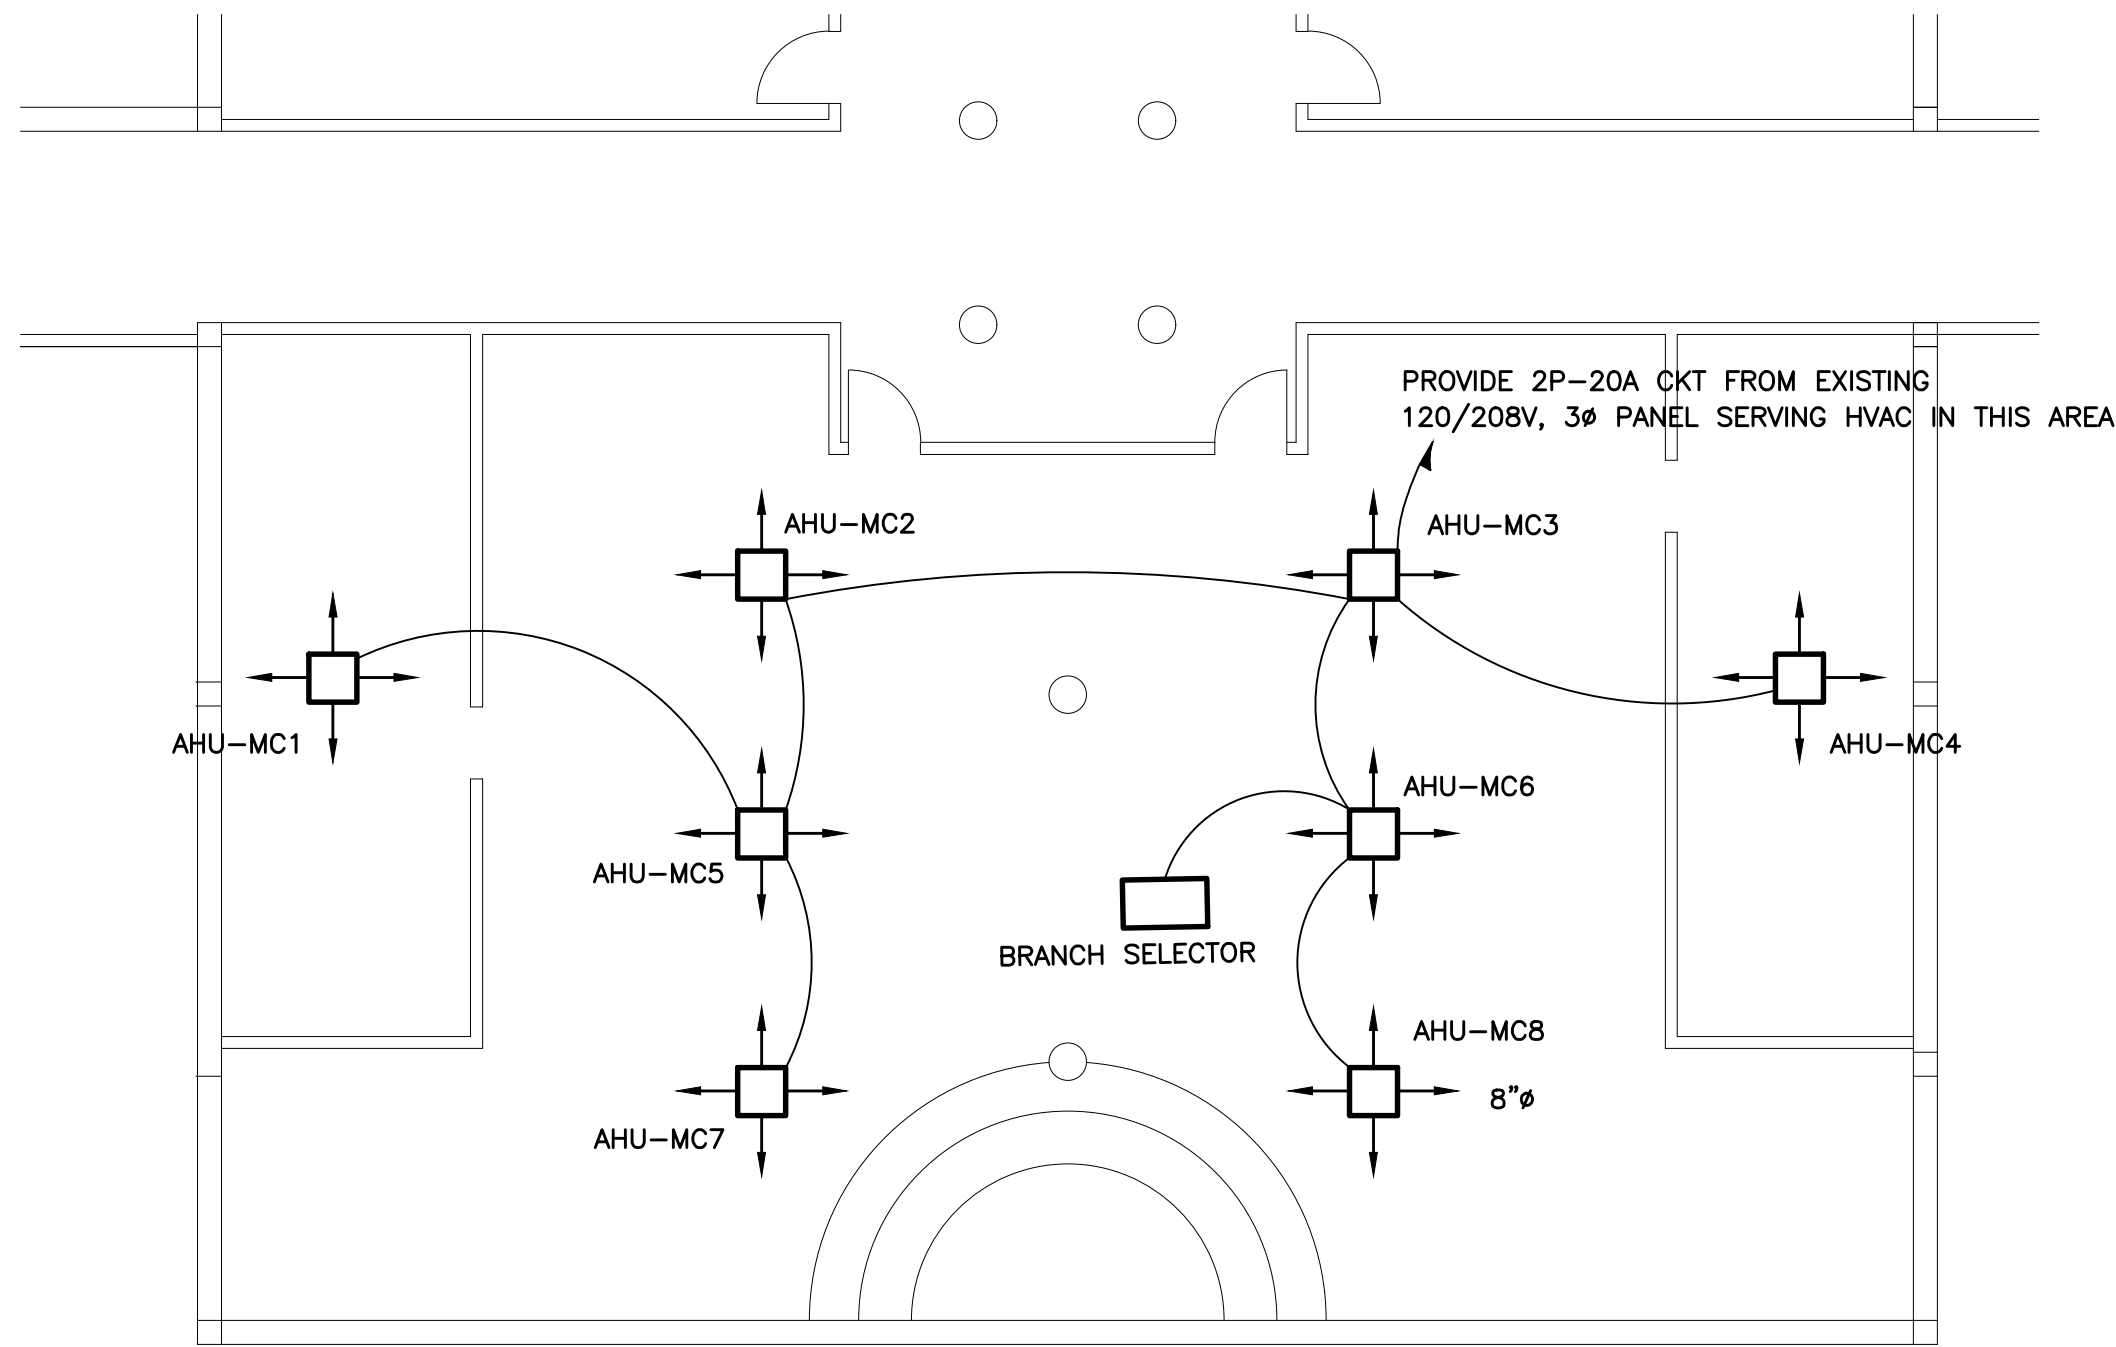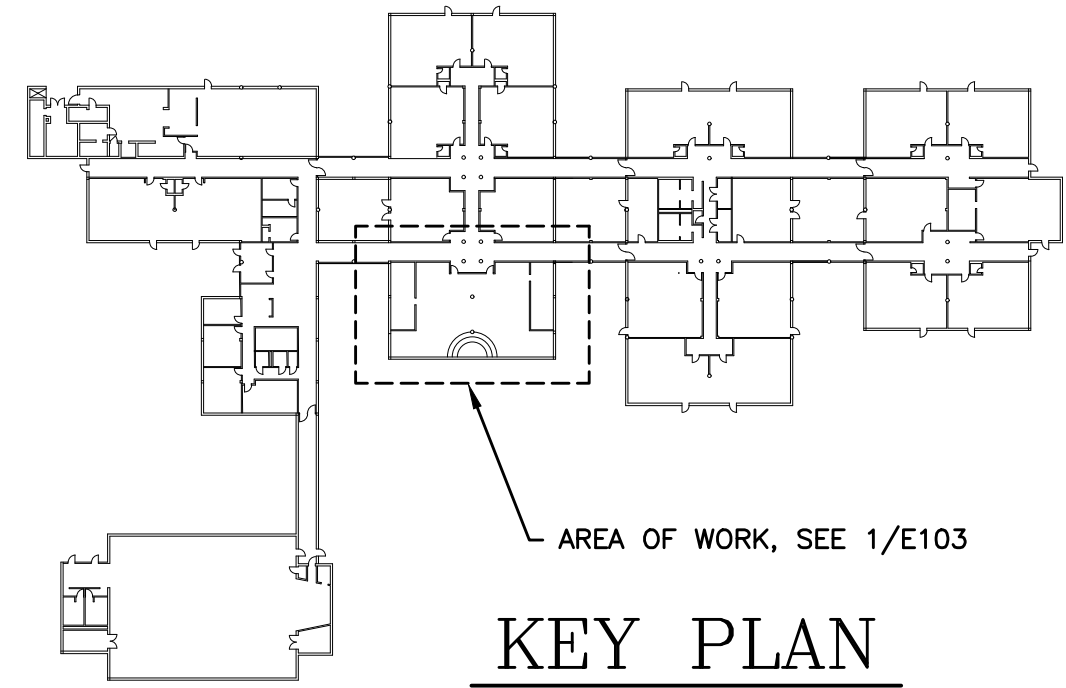


MEDIA CENTER FLOOR PLAN –
HVAC (ALTERNATE BID #3)

1
E104

SCALE: 1/8" = 1'-0"

POWER NOTES:

1. TYPE MC CABLE WITH COPPER CONDUCTORS AND GREEN GROUND MAY BE USED FOR CONCEALED BRANCH CIRCUITS. REDHEAD BUSHINGS SHALL BE PROVIDED AT EACH TERMINATION.
2. ALL CIRCUITS SHALL HAVE EQUIPMENT GROUNDING CONDUCTORS.
3. UNLESS OTHERWISE NOTED FOR 20-AMP CKTS: #10 AWG SHALL BE USED FOR CKTS LONGER THAN 75 FEET. #12 AWG SHALL BE USED FOR CKTS SHORTER THAN 75 FEET.
4. CONDUCTOR SIZES SMALLER THAN #8 AWG SHALL BE SOLID.
5. PROVIDE AND INSTALL CONDUIT FOR HVAC CONTROL WIRING AS REQUIRED. SEE HVAC PLAN FOR T-STATS.
6. FIRESTOP ALL PENETRATIONS THROUGH RATED ASSEMBLIES.

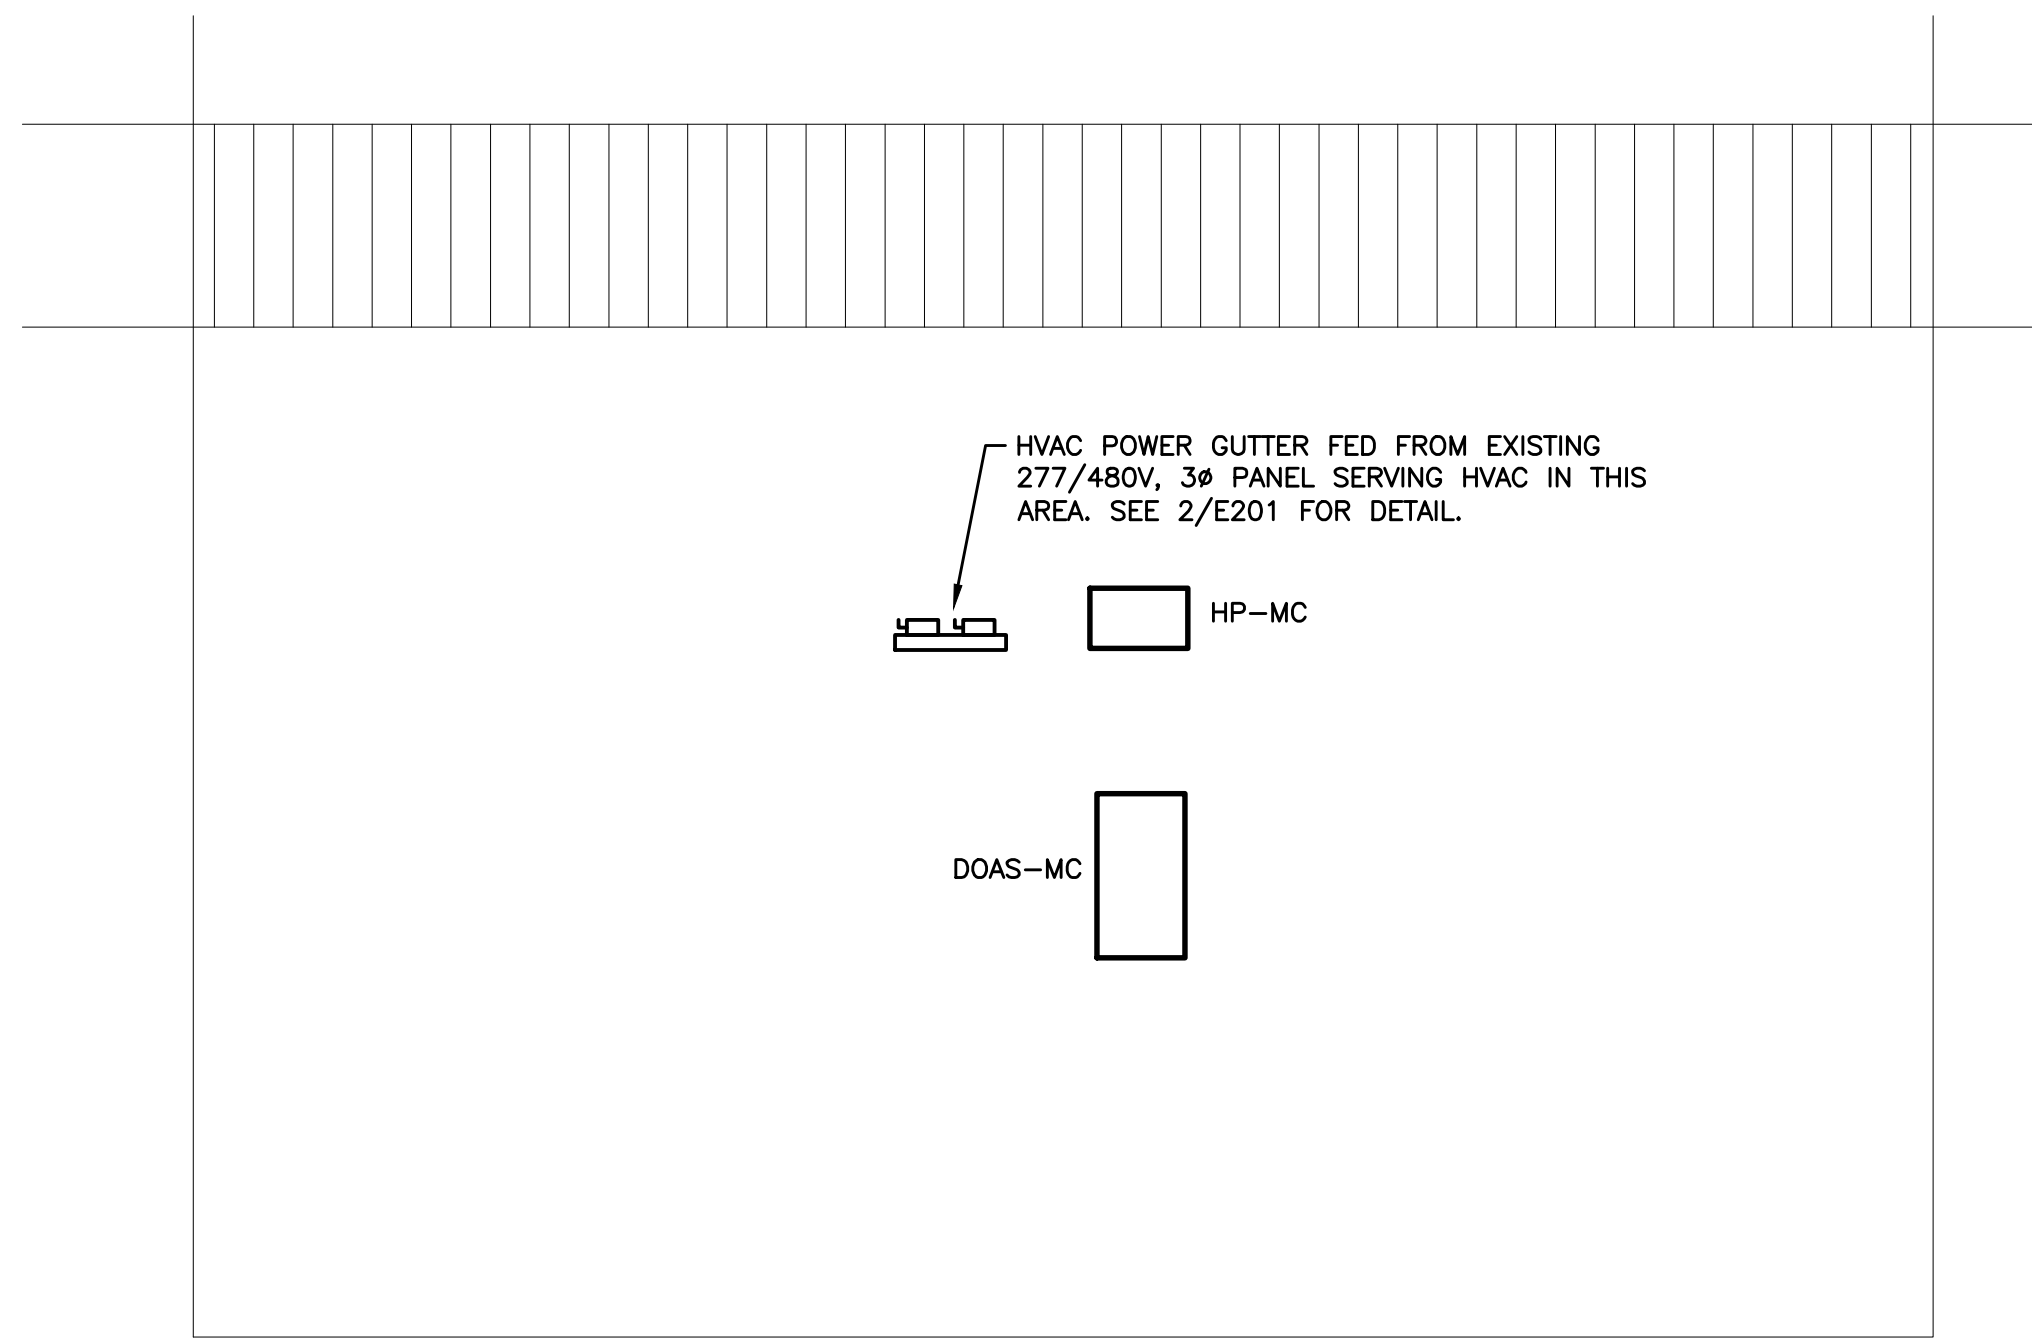


MEDIA CENTER ROOF PLAN –
HVAC (ALTERNATE BID #3)

1
E104

SCALE: 1/8" = 1'-0"

derek@simsengineers.com

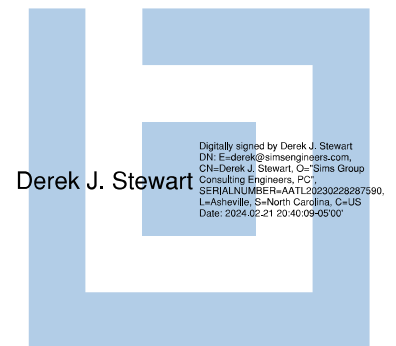

Derek J. Stewart
Digital signed by Derek J. Stewart
DN: cn=Derek J. Stewart, o=Sims Group
Engineers, PC, email=derek@simsengineers.com,
c=US, ou=Engineering, serial=10000000000000000000
Date: 2024.02.21 10:00:00 -0500

ATKINSON ELEMENTARY SCHOOL

HVAC CHANGEOUT PHASE I
2510 OLD KANUGA RD. HENDERSONVILLE, NC 28739

DATE: 02/21/24


DESIGN BY: DJS

DRAWN BY: RKH/PAM

APPROVED BY: DJS

SHEET NUMBER:


E104

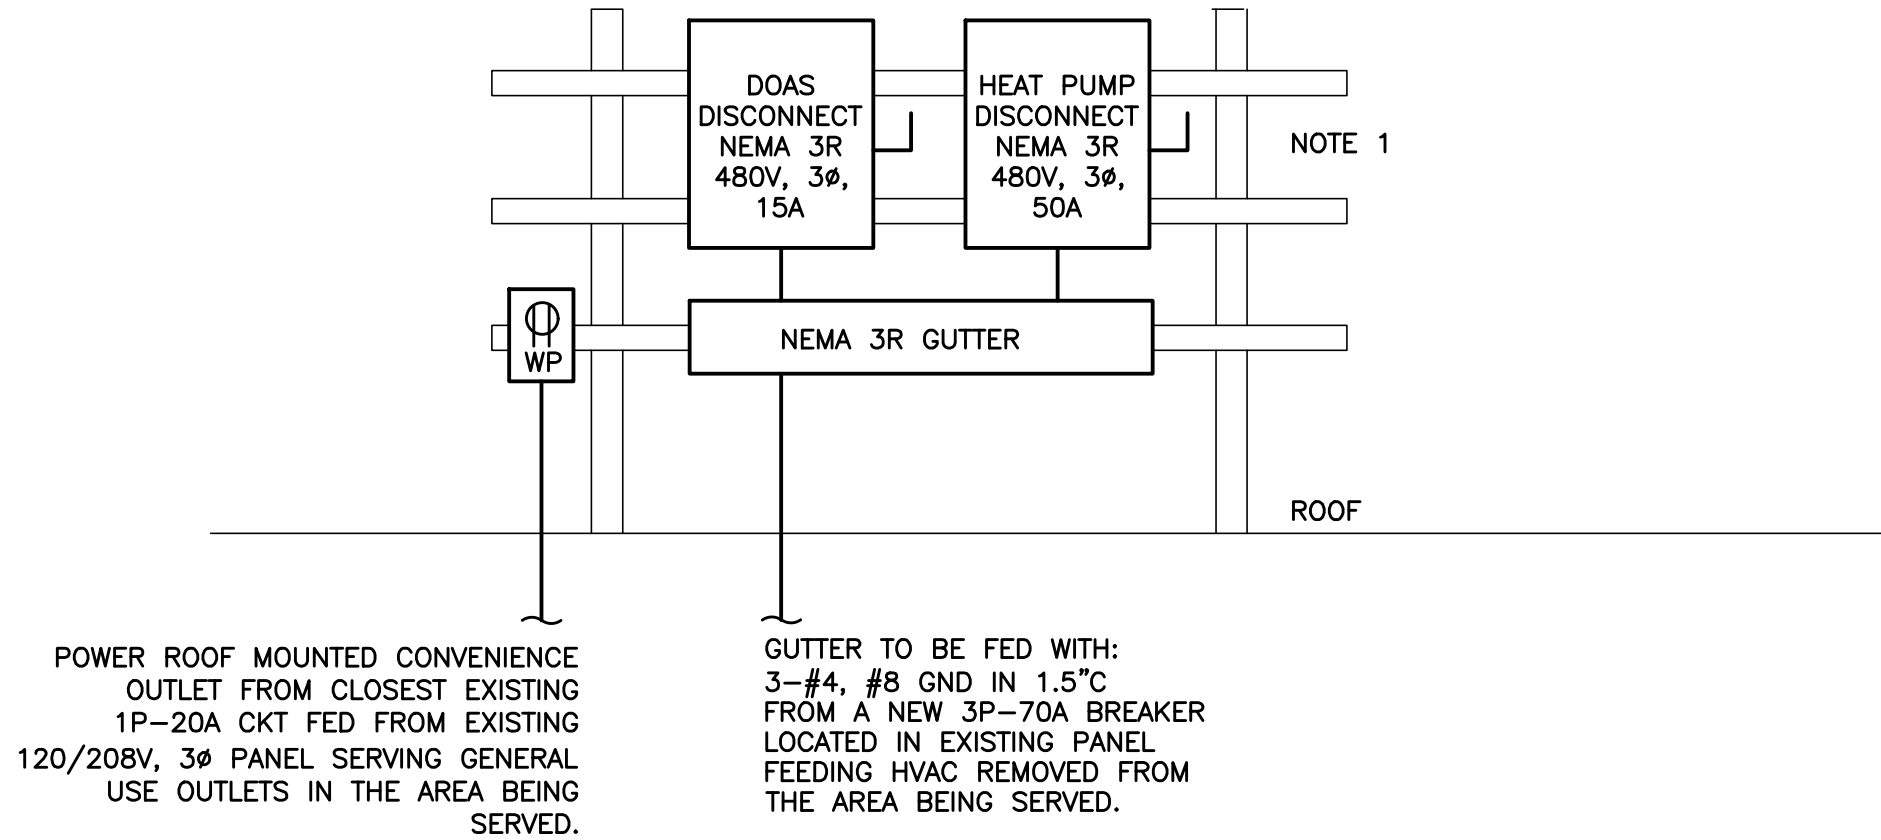

1 HVAC POWER GUTTER – TYPICAL DETAIL

E201 NOT TO SCALE

- NOTES:
1. PROVIDE MINIMUM 1.625" GALVANIZED CHANNEL STRUT FOR ALL RACK FRAMING AND SUPPORTS. USE GALVANIZED FASTENERS, STRAPS, FITTINGS, ETC ONLY. COAT ALL FIELD CUTS OF STRUT OR HARDWARE WITH COLD GALVANIZING SPRAY.
 2. THIS DETAIL APPLIES TO ALL REFERENCES ON SHEETS E101, E102, & E103.
 3. SEE 2/E102 FOR MEDIA CENTER HVAC POWER GUTTER DETAIL.

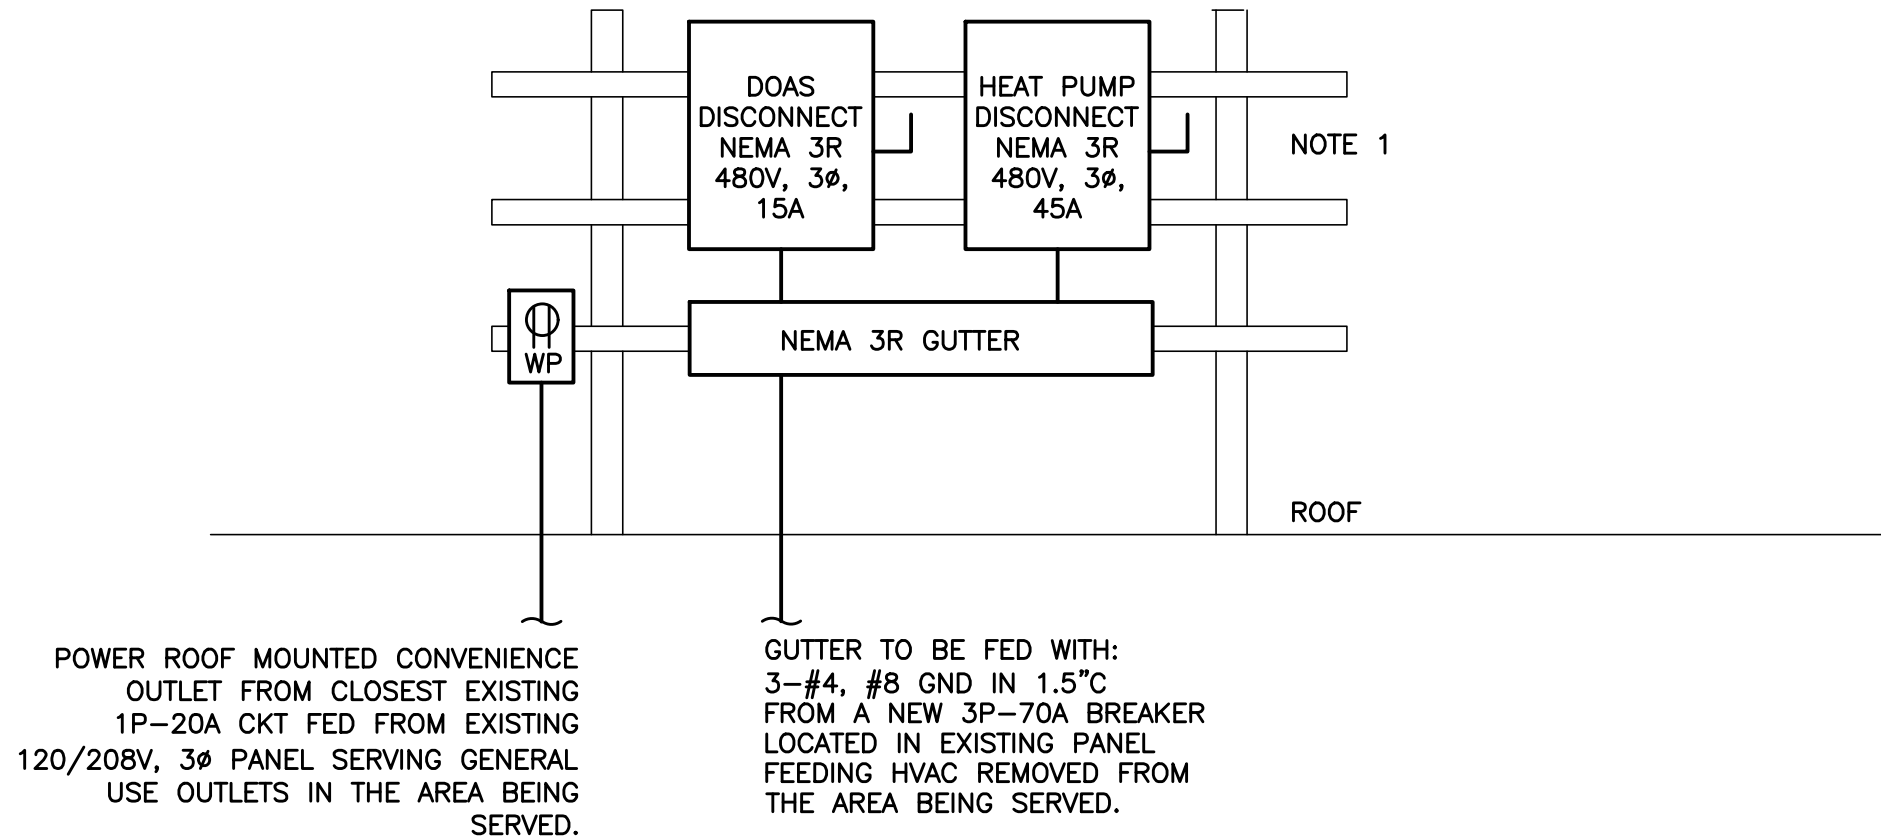

2 HVAC POWER GUTTER – MEDIA CENTER

E201 NOT TO SCALE

- NOTES:
1. PROVIDE MINIMUM 1.625" GALVANIZED CHANNEL STRUT FOR ALL RACK FRAMING AND SUPPORTS. USE GALVANIZED FASTENERS, STRAPS, FITTINGS, ETC ONLY. COAT ALL FIELD CUTS OF STRUT OR HARDWARE WITH COLD GALVANIZING SPRAY.
 2. THIS DETAIL APPLIES TO THE MEDIA CENTER ONLY

ELECTRICAL LEGEND	
SYMBOL	DESCRIPTION
\$	SINGLE POLE TOGGLE SWITCH, BRASS TERMINAL SCREWS, 20 A PASS & SEYMOUR COMMERCIAL GRADE (SEE NOTE 3)
\$3	3-WAY, 20A TOGGLE SWITCH, BRASS TERMINAL SCREWS, PASS & SEYMOUR COMMERCIAL GRADE (SEE NOTE 3)
\$0	LED DIMMER, 0-10V PASS & SEYMOUR COMMERCIAL GRADE (SEE NOTE 3)
\$03	3-WAY, LED DIMMER, 0-10V PASS & SEYMOUR COMMERCIAL GRADE (SEE NOTE 3)
W	OCCUPANCY SENSOR, PIR, WALL MOUNT, 800 WATT, LINE VOLTAGE WATTSTOPPER COMMERCIAL GRADE (SEE NOTE 3)
WD	OCCUPANCY SENSOR WITH 0-10V DIMMER, WALL MOUNT, 800 WATT, LINE VOLTAGE WATTSTOPPER COMMERCIAL GRADE (SEE NOTE 3)
DT	OCCUPANCY SENSOR, DUAL TECHNOLOGY, WALL MOUNT, 800 WATT, LINE VOLTAGE WATTSTOPPER COMMERCIAL GRADE (SEE NOTE 3)
DT	OCCUPANCY SENSOR, DUAL TECHNOLOGY, CEILING MOUNT, 800 WATT, LINE VOLTAGE WATTSTOPPER COMMERCIAL GRADE (SEE NOTE 3)
TC	TIMECLOCK USED FOR LIGHTING CONTROL SEE DETAIL ON LIGHTING PLAN SHEET
Q	OUTLET BOX WITH 20A TOGGLE SWITCH AS DISCONNECT MEANS
	HEAVY DUTY SAFETY SWITCH, FUSIBLE, 240 V, EQUIPMENT GROUND, NEMA 3R IF OUTSIDE, CLASS R REJECTION KIT, FUSE WITH BUSS #FRN-R
	DUPLEX RECEPTACLE, 20 AMP, BRASS STRAP AND BRASS SCREWS PASS & SEYMOUR COMMERCIAL GRADE
	TWO DUPLEX RECEPTACLES IN 4x4 BOX PASS & SEYMOUR COMMERCIAL GRADE
GF	DUPLEX RECEPTACLE, GROUND FAULT CIRCUIT INTERRUPTING, 20 AMP, AUTO SELF TEST PASS & SEYMOUR COMMERCIAL GRADE
WP	DUPLEX RECEPTACLE, 20-AMP, GFCI, WEATHER RESISTANT, WITH WP-IN-USE ALUMINUM COVER PASS & SEYMOUR COMMERCIAL GRADE
	EQUIPMENT HARD-WIRED OR SPECIAL PURPOSE RECEPTACLE FIELD VERIFY TO MATCH EQUIPMENT
JB	JUNCTION BOX OR FLUSH MOUNTED BLANK OUTLET BOX EC SHALL VERIFY SIZE OF BOX NEEDED
TTB	TELEPHONE TERMINAL BOARD SEE DETAIL THIS SHEET
	DATA/COMM OUTLET. INSTALL BOX AND 0.75" CONDUIT WITH PULL CORD TO ACCESSIBLE AREA OR TO TTB AS REQUIRED. TERMINATE CONDUIT WITH BUSHING IF STUBBED OUT ABOVE CEILING OR BELOW FLOOR. BOX AND CONDUIT BY EC. JACKS, PLATE, AND CABLE BY OWNER'S TELEPHONE CONTRACTOR.
RFB	RECESSED FLOOR BOX: 1 DUPLEX RECEPTACLE, 1 DATA/COMM BRACKET, 0.75" CONDUIT TO TTB FOR DATA/COMM, DATA/COMM PLATES, JACKS AND CABLE SHALL BE PROVIDED BY OWNER'S COMMUNICATIONS CONTRACTOR. FINISHES SELECTED BY OWNER. PASS & SEYMOUR/WIREMOLD COMMERCIAL GRADE
TV	TELEVISION OUTLET LOCATION. PROVIDE DUPLEX RECEPTACLE AND DATA/COMM OUTLET AS LISTED IN THIS SCHEDULE. COORDINATE EXACT LOCATION AND MOUNTING HEIGHT WITH OWNER.
	EXHAUST FAN, SWITCH WITH LIGHTS U.O.N. SUPPLIED AND INSTALLED BY MC CONNECTED BY EC

- NOTES:
1. THIS LEGEND REPRESENTS A STANDARD EQUIPMENT LIST. SOME DEVICES LISTED ABOVE MAY NOT APPLY TO THIS PROJECT.
 2. FINISHES FOR DEVICES AND WALLPLATES SHALL BE SELECTED BY ARCHITECT U.O.N.
 3. EC SHALL VERIFY THAT LIGHTING CONTROL DEVICES ARE COMPATIBLE WITH THE FIXTURES BEING CONTROLLED.

DATE: 02/21/24

DESIGN BY: DJS

DRAWN BY: RKH/PAM

APPROVED BY: DJS

SHEET NUMBER:

E201

BASIC ELECTRICAL REQUIREMENTS

1.1 SECTION INCLUDES

1.2 SCOPE OF WORK

1.3 WORK SEQUENCE

1.4 REGULATORY REQUIREMENTS

1.5 PROJECT/SITE CONDITIONS

1.6 SUBSTITUTIONS:

1.7 EXCAVATING FOR ELECTRICAL WORK

D. Sequencing: Delay backfill and encasement of conduit until testing of conductors has been completed.

2.1 Coordinate work with other Trades.

2.2 General:

2.3 Design Requirements vs. Code Minimum Requirements.

1. Insulation type.
2. Conductor size.
3. Conduit type.
4. Conduit couplings.
5. Size of equipment grounding conductor. See NEC section 250.4A5.

3. PART 3 CONDUCTORS & CONDUIT

3.1 Conductors:

3.2 Conduit and Raceway:

4. PART 4 DOCUMENTS AND SUBMITTALS

4.1 SUBMITTALS

G. Test Reports (if required): 3 copies

H. Warranties: 6 copies, including 3 for maintenance manuals.

I. Maintenance Manuals: 3 complete sets in loose-leaf 3-ring binders, with rigid permanent vinyl covered back and front. Separators with index tabs shall be provided. One set shall have all sheets individually encased in clear, plastic document protectors.

5. PART 5 ELECTRICAL WORK CLOSEOUT

5.6 Turn-Over of Operations: At the time of substantial completion, turn over the prime responsibility for operation of the electrical equipment and systems to the Owner's operating personnel. However, until the time of final acceptance, provide one electrician, who is completely familiar with the work, to consult with and continue training the Owner's personnel.

END OF SECTION



ATKINSON ELEMENTARY SCHOOL
HVAC CHANGEOUT PHASE I
2510 OLD KANUGA RD. HENDERSONVILLE, NC 28739

DATE: 02/21/24

DESIGN BY: DJS

DRAWN BY: RKH/PAM

APPROVED BY: D/S

SHEET NUMBER:

E301